



PAW NA Limited Partnership
45 Davis Street, Webster, MA 01570
Tel.: +1-508-943-4240, Fax: +1-508-943-4141
Email: info@paw.eu, Web: www.paw.eu

Installation and Commissioning Manual

Solar Stations FlowCon C+ Evolution II

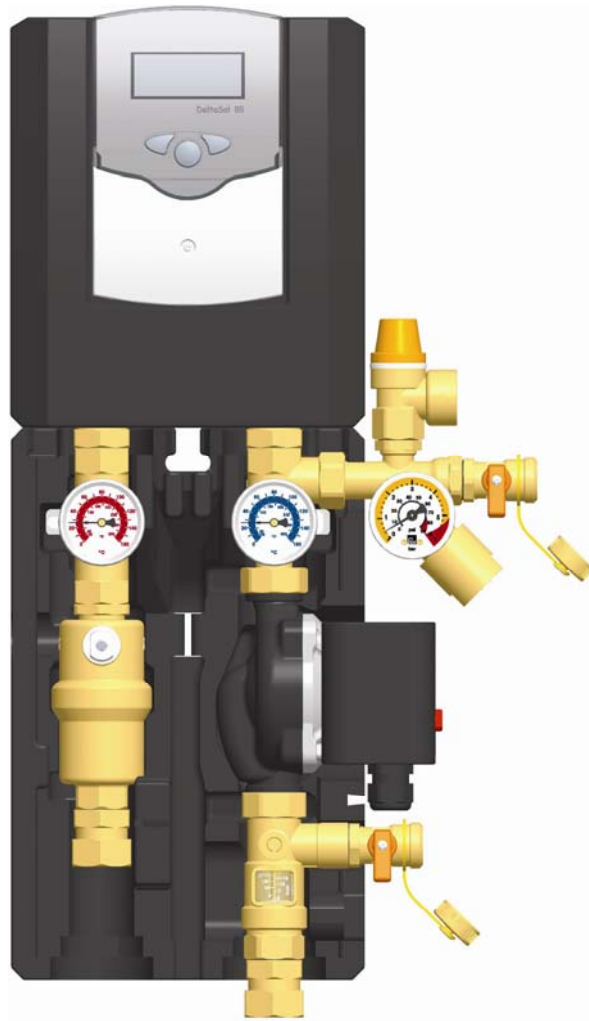




Table of Contents

1	For your safety	3
1.1	About this manual	3
1.2	Designated use	3
1.3	Qualification of the installer	4
1.4	Hand-over of the system [specialist]	4
1.5	General safety instructions.....	5
1.6	General instructions regarding solar fluid	6
2	Description of the product.....	7
3	Assembly and installation [specialist].....	8
4	Commissioning [specialist]	11
4.1	Flushing and filling the solar circuit [specialist].....	12
4.2	Preparation for flushing [specialist]	14
4.3	Flushing and filling [specialist].....	14
4.4	Setting the solar thermal system [specialist]	17
5	Cleaning.....	18
6	Maintenance and decommissioning [specialist]	18
6.1	Partial draining of the solar installation [specialist].....	19
6.2	Complete draining of the solar installation [specialist].....	19
6.3	Replacing the pump [specialist]	20
6.4	Replacing the gaskets in the solar station [specialist]	20
6.5	Dismounting [specialist]	21
7	Application range of the check valves [specialist].....	22
8	Spare parts [specialist]	24
9	Technical data and pressure drop characteristic.....	25
10	Commissioning log.....	27

1 For your safety



Carefully read this manual before installation and commissioning. Non-observance of the instructions in this manual may lead to serious material damage and serious injuries that may result in death.

- Keep this manual in close proximity of the system for later use.

⚠ WARNING	indicates that there is risk of death, serious injuries or considerable material damage if suitable safety precautions are not taken.
⚠ CAUTION	indicates that there is a risk of light injuries if suitable safety precautions are not taken.
NOTICE	indicates that there is a risk of material damage if suitable safety precautions are not taken.

1.1 About this manual

This manual describes the function, installation, commissioning and operation of the solar stations FlowCon C+ Evolution II. The chapters called [specialist] are only addressed to specialists.

For other components of the solar installation, such as collectors, storage tanks, expansion tanks, and controllers, please refer to the instructions of the corresponding manufacturer.



1.2 Designated use

The solar station is a pre-assembled fitting assembly checked for tightness and used for recirculating the solar fluid in the solar circuit. The solar station must only be used in solar thermal systems as pumping station in the solar circuit, taking into consideration the technical limit values indicated in this manual. The station may only be assembled indoors. The station must be assembled and operated as described in this manual!

Using the station contrary to its designated use will invalidate all liability claims.

Only use accessories from PAW.

1.3 Qualification of the installer

Installation and commissioning of this equipment should be done by qualified installers [specialist] in accordance with local, state and federal codes which may be applicable.

The following must also be observed during installation and commissioning:

- Relevant regional and national regulations (for example Occupational Safety and Health Act)
- Relevant accident prevention regulations (for example of the Employer's Liability Insurance Association)
- Instructions and safety instructions mentioned in this manual

1.4 Hand-over of the system [specialist]

After installation and commissioning, the installer is responsible for familiarizing the end user with the functions of the system and the basic safety measures.

- After commissioning, fill in the log on the last page of this manual.
- Hand the manual over to the end user. Instruct the end user to keep the manual in close proximity to the system.
- Instruct the end user to have the solar station serviced and repaired by a specialist only. The controller settings must not be changed by the customer.
- Explain to the end user the function of the system and of the safety devices. Point out to the end user that the shell must remain mounted during operation and that the ball valves with temperature gauges and the ball valve in the flowmeter must be open.

1.5 General safety instructions

Before installing and commissioning the product, you must read and observe the following safety instructions:

WARNING

Danger of scalding due to escaping vapor!



If the system pressure is too high, hot solar fluid will escape from the pressure relief valves and can result in scalding.

- Flush and fill the system only if the collector temperatures are below 150 °F (70 °C).
- Connect a discharge line to the safety assembly. Observe the instructions regarding the pressure relief valve.
- The pressures calculated by the installation planner for the expansion tank and the operating pressure of the installation must be set.

CAUTION

Risk of burns!



The valves and fittings and the pump may heat up to more than 212 °F (100 °C) during operation.

- The shell must remain closed during operation.

CAUTION

Personal injury and material damage caused by excess pressure!



Closing both ball valves will disconnect the safety assembly from the heat exchanger.

Heating the storage tank can result in the formation of high pressures, which may lead to material damage and personal injury!

- In operation, the ball valves with temperature gauges and the ball valve at the flowmeter must always be open.
- Close the ball valves only when service is required.

NOTICE

Material damage due to mineral oils!

Mineral oil products permanently damage the EPDM sealing elements, resulting in a loss of their sealing characteristics. We cannot be held liable for damage caused by seals thus damaged, nor will we offer a replacement under warranty.

- It is imperative to prevent the EPDM sealing elements from making contact with substances containing mineral oils.
- Use silicone- or polyalkylene-based lubricants free of mineral oil, such as Unisilikon L250L and Syntheso Glep 1 from the company Klüber or a silicone spray.

1.6 General instructions regarding solar fluid

WARNING

Propylene glycol: hazardous in case of ingestion!

Propylene glycol is hazardous in case of ingestion. It is irritant in case of eye or skin contact.


- Wear chemical resistant protective gloves and safety glasses with side-shields when handling propylene glycol mixtures.
 - Observe the instructions of the antifreeze manufacturer.
-

It often happens that solar thermal systems cannot be completely drained after flushing. Thus, there is a risk of frost damage when flushing with water. Therefore, the solar thermal system should only be flushed and filled with the solar fluid used later on.

Strictly follow the instructions of the antifreeze manufacturer for operating a solar thermal system. All components in the solar station are resistant to a percentage of propylene glycol of up to 50%.


Determine quantity according to system volume. See instructions of the collectors, storage tank and expansion tank.

2 Description of the product

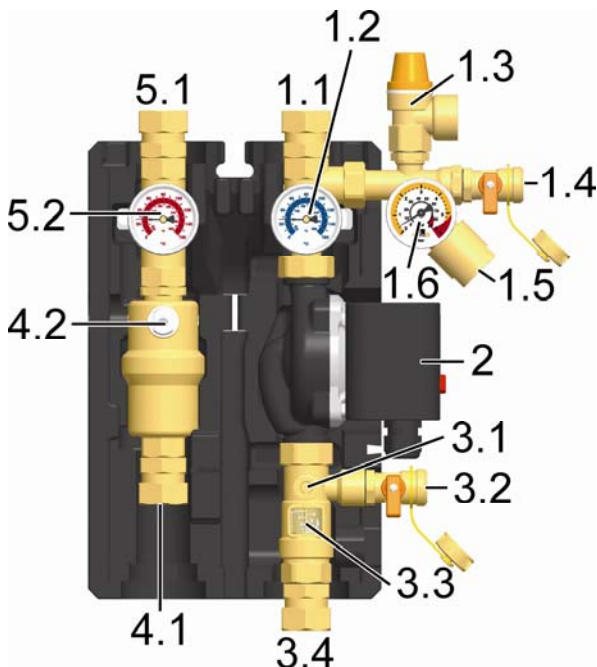

The solar station is mounted on a wall support and held by clip springs. The station contains a preset controller, important valves, fittings and safety equipment for operating a solar thermal system:

- 1.1 Return to the collector field
- 1.2 Ball valve with temperature gauge in the return equipped with replaceable spindle (blue)
- 1.3 Pressure relief valve, 87 psi / 6 bar
- 1.4 Fill valve
- 1.5 Connection for the expansion tank
- 1.6 Pressure gauge 87 psi / 6 bar
- 2 Solar pump
- 3.1 Ball valve in flowmeter
- 3.2 Drain valve
- 3.3 Flowmeter
- 3.4 Return from the storage tank
- 4.1 Supply to the storage tank
- 4.2 Airstop equipped with manual bleeder
- 5.2 Ball valve with temperature gauge in the supply equipped with replaceable spindle (red)
- 5.1 Supply from the collector field

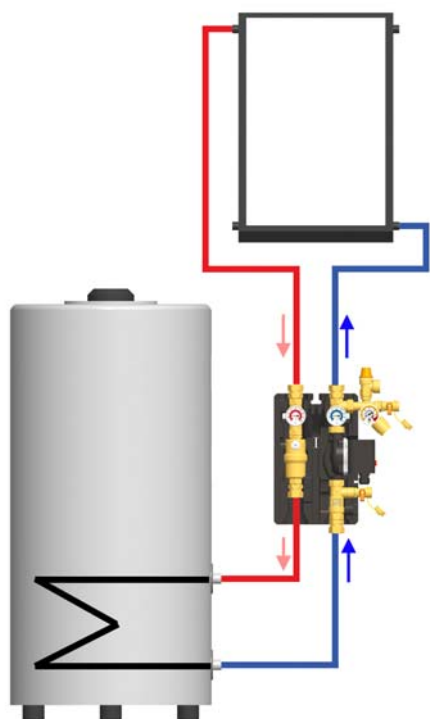

Assembly example

3 Assembly and installation [specialist]


The solar station may only be installed indoors with a power supply of 120 V / 60 Hz. The installation site must be dry, stable and frost-free.

NOTICE


Material damage due to high temperatures!

Since the solar fluid may be very hot near the collector, the fitting assembly must be installed at a sufficient distance from the collector field.


➤ It may be necessary to install an upstream tank, in order to protect the expansion tank.

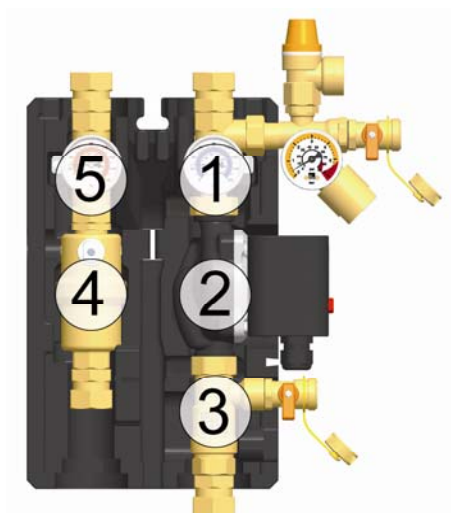

1. Remove the station from the packaging.
2. Pull off the front shell.

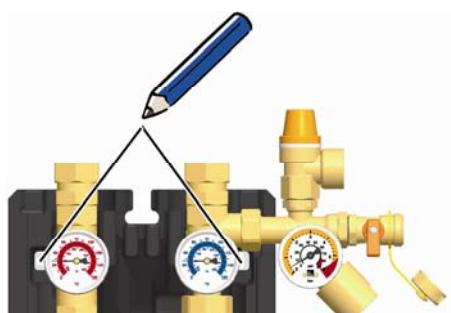

3. Copy the mounting holes next to the temperature gauges of the solar station to the mounting surface.
4. Drill the holes and fasten the solar station to the wall by means of the enclosed screws and, if required, the enclosed wall anchors.

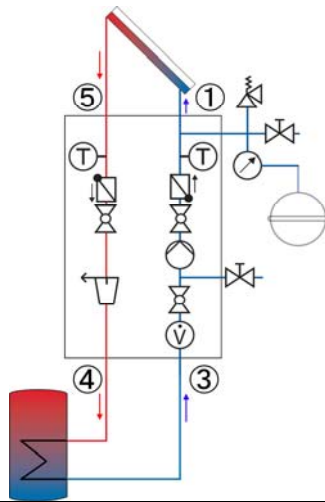


5. Connect the solar station to the system by means of pipes


- ⑤ Supply from collector field
- ① Return to the collector field
- ④ Supply to the storage tank
- ③ Return from the storage tank

All screw connections are designed as cutting-ring compression fitting $\frac{3}{4}$ " male thread x 22 mm.

Assembly of the cutting-ring compression fitting:

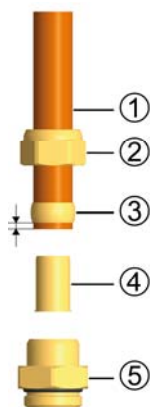


- Push the union nut ② and the cutting ring ③ onto the copper pipe ①. The pipe must protrude at least $\frac{1}{8}$ " (3 mm) from the cutting ring in order to ensure the force transmission and the sealing.
- Insert the support sleeve ④ into the copper pipe.
- Insert the copper pipe with the plugged-on individual parts (②, ③ and ④) all the way into the housing of the cutting-ring fitting ⑤.
- First screw the union nut ② manually.
- Tighten the union nut ② by rotating it by one full turn. Secure the housing of the cutting-ring fitting ⑤ against distortion in order to avoid damaging the sealing ring.

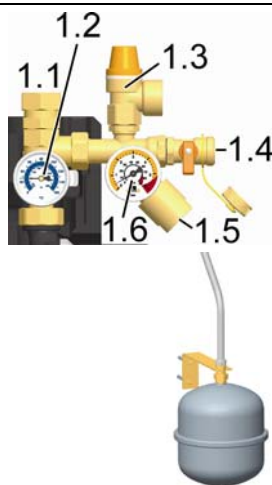

Available as an option!

6. Connect a discharge line to the connection [1.3] at the pressure relief valve. Conduct the discharge line into a heat-resistant container. Secure the discharge line such that in the event of escaping vapor people in the vicinity are not put at risk.
7. Connect the connecting line for the expansion tank below the pressure gauge [1.5] and fasten the holder for the expansion tank.
8. Adapt the initial pressure of the expansion tank to the system and connect the expansion tank. Observe the manufacturer's separate instructions of the expansion tank! Also observe the layout of the installation planner.
9. Check all screw connections and retighten them, if necessary.

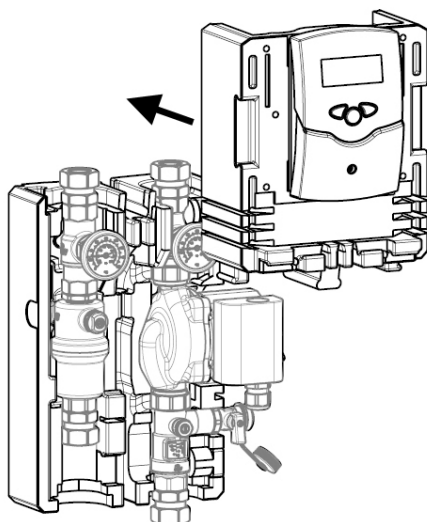


10. Slide the insulation extension with the premounted controller onto the solar station.

⚠ WARNING

Risk of electric shock!



- Prior to commencing electrical work, pull the mains plug!
- Only after completing all installation work, flushing and filling should the mains plug of the controller be plugged into a socket! This avoids an unintentional start of the motors.

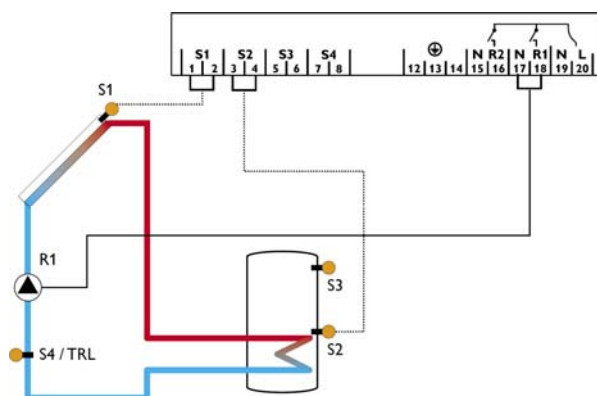

11. Connect the sensors and the pump to the controller. Observe the separate instructions of the controller! The illustration shows the terminal configuration for a standard solar thermal system.

The assembly of the solar station is now complete, and you can commission the station.

4 Commissioning [specialist]

Before commissioning the station, you must read and observe the following safety instructions:

WARNING

Risk of burns and scalding!



The valves and fittings may heat up to more than 212 °F (100 °C). During flushing, filling and venting, the solar fluid can escape as vapor and result in scalding.

- Flush and fill the system only if the collector temperatures are below 150 °F (70 °C).
-

WARNING

Propylene glycol: hazardous in case of ingestion!

Propylene glycol is hazardous in case of ingestion. It is irritant in case of eye or skin contact.

- Wear chemical resistant protective gloves and safety glasses with side-shields when handling propylene glycol mixtures.
 - Observe the instructions of the antifreeze manufacturer.
-

NOTICE

Risk of frost!

It often happens that solar thermal systems cannot be completely drained after flushing. Thus, there is a risk of frost damage when flushing with water.

- Therefore, the solar thermal system should only be flushed and filled with the solar fluid used later on.
- Use a water and propylene glycol mixture with max. 50% of propylene glycol as solar fluid, in order to avoid damaging the seals.

NOTICE

Note regarding the commissioning sequence

- When commissioning the system, first fill the storage circuit and then the solar circuit. This guarantees that any absorbed heat can also be dissipated.


4.1 Flushing and filling the solar circuit [specialist]

The fill and drain connections required for flushing and filling have been integrated into the solar station.

In order to flush any dirt particles that may still be present out of the system, use only flush and fill stations equipped with suitable micro filters.


Ball valve with integrated check valve

(Normal direction of flow in the picture: downstream)

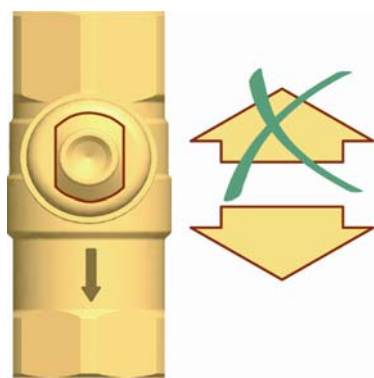


0°

Check valve in operation,
through-flow in flow direction only.

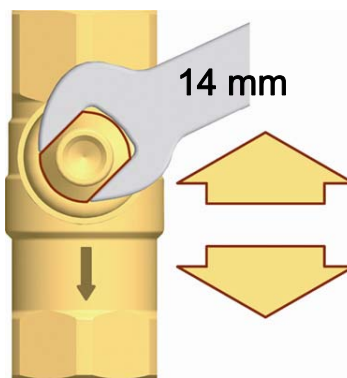

45°

Check valve not in operation,
through-flow in both directions.

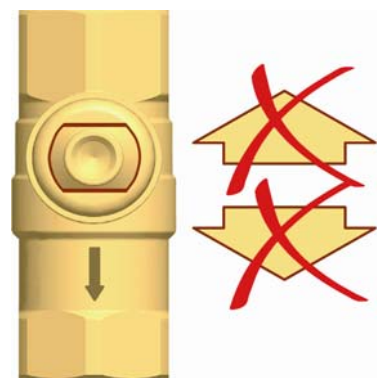

90°


Ball valve closed,
no through-flow.

Airstop

The airstop with manual bleeder is used to bleed the solar thermal system. To ensure a perfect ventilation of the solar circuit, the flow velocity must be at least 0.3 m/s in the supply.

Pipe diameter	Flow rate at 0.3 m/s [US gpm]	Flow rate at 0.3 m/s [l/min]
1/2"	0.63	2.4
3/4"	1.49	5.6

The air liberated from the solar fluid is collected in the upper area of the airstop and can be discharged via the vent plug [4.2].

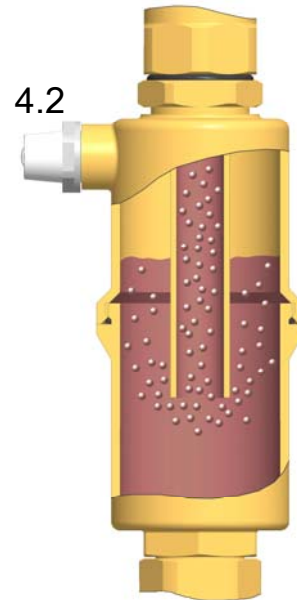

WARNING

Danger of scalding due to escaping vapor!




The escaping solar fluid can have a temperature of more than 212 °F (100 °C) and cause scaldings.

➤ Carefully open the vent plug and close it again, as soon as medium escapes.

Venting the solar thermal system after commissioning

At the beginning, vent the solar thermal system daily and then weekly or monthly, depending on the vented air quantity. This ensures optimum operation of the solar thermal system. Check the system pressure after venting and increase it to the prescribed operating pressure, if necessary.

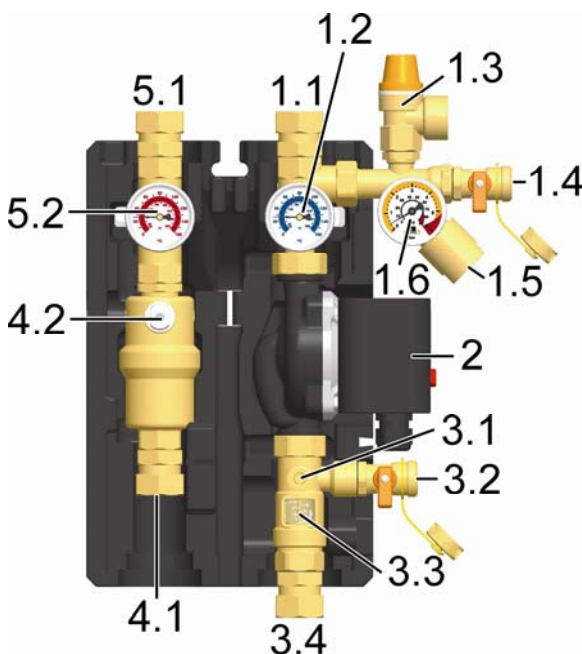


4.2 Preparation for flushing [specialist]


The solar circuit is flushed in the direction of flow.

1. Disconnect the expansion tank from the solar thermal system! Please observe the manufacturer's instructions.
2. Open the check valves in the supply and return by turning the ball valves [1.2|5.2] to position 45° (see page 12).
3. Close the ball valve [3.1] in the flowmeter.
4. Connect the flush and fill station to the solar station:
 - Pressure hose to the fill connection [1.4]
 - Flushing hose to the drain connection [3.2]

4.3 Flushing and filling [specialist]

1. Open the fill and drain valves [1.4|3.2]
2. Put the flush and fill station into operation and keep flushing until clear medium escapes.
3. Vent the solar thermal system several times at the vent plug of the airstop [4.2] during flushing until the solar fluid escapes without forming bubbles (see page 13).

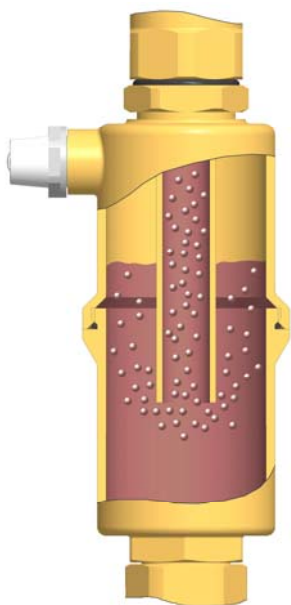

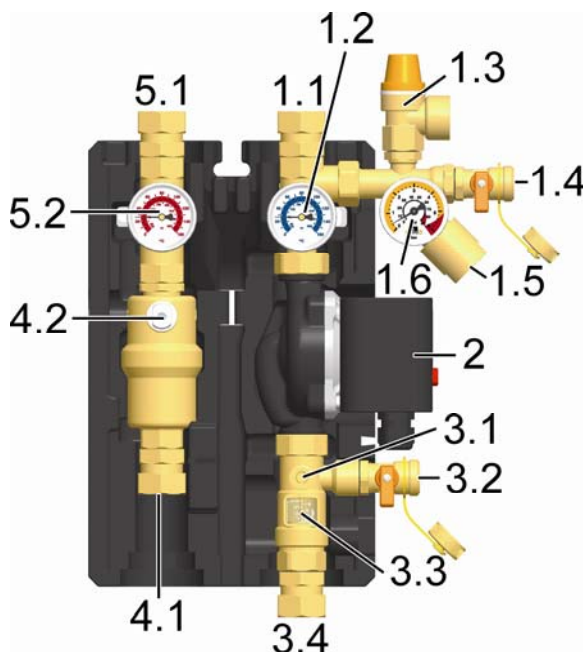

4. Close the drain valve [3.2] with the filling pump running and increase the system pressure, depending on the design of the system, to max. 5 bar. The pressure can be read on the pressure gauge. Close the fill valve [1.4] and switch off the pump of the flush and fill station.



Check the pressure on the pressure relief valve
(87 psi/6 bar)!

5. Check at the pressure gauge if the system pressure is dropping and eliminate any leaks, if present.
6. Reduce the pressure on the drain valve [3.2] to the system-specific pressure.
7. Connect the expansion tank to the solar circuit and set the operating pressure of the solar thermal system by means of the flush and fill station (for the required operating pressure, see instructions of the expansion tank).
8. Close the fill and drain valves [1.4|3.2].
9. Open the ball valve [3.1] in the flowmeter.
10. Set the check valves in the ball valves [1.2 | 5.2] to operating position (0°, see page 12).

! WARNING

Risk of electric shock!



- Check if the sensors and the pump are properly connected to the controller and if the controller housing is closed. Only then should the mains plug of the controller be plugged into a socket.



11. Connect the controller to the mains and set the solar circuit pump in the manual mode to ON as described in the controller manual. Run the solar circuit pump at maximum rotation speed for at least 15 minutes.

In the meantime, vent the solar thermal system several times at the vent plug of the airstop until the solar fluid escapes without forming bubbles (see page 13).

If necessary, increase the system pressure to the operating pressure again.

12. Remove the hoses of the flush and fill station and screw the the closure caps on the fill and drain valves.

The closure caps are only for protection against soiling. They have not been constructed for high system pressures, their tightness being guaranteed by the closed ball valves.


Correct



Incorrect



4.4 Setting the solar thermal system [specialist]

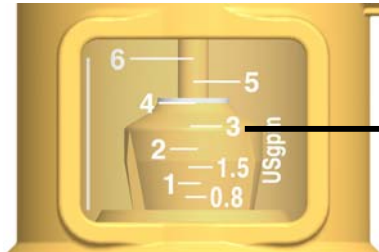

Scale: 0.8-6 USgpm or 3-22 l/min
(The unit is specified on the scale)

Reading edge =

Round edge of the floating body

Example: approx. 3 USgpm

Observe the specifications of the manufacturer of the collectors for the correct adjustment of the flow rate.

1. Set the desired max. flow rate via the rotation speed of the solar pump. The controller will set the speed accordingly.
In exceptional cases, the flow rate can also be reduced via the ball valve [3.1].
2. Mount the front shell on the solar station.
3. Set the controller to automatic mode (see controller manual).

5 Cleaning

CAUTION

Risk of burns!



The valves and fittings and the pump may heat up to more than 212 °F (100 °C) during operation.

- The shell must remain closed when cleaning.

Clean the solar station only from the outside with a damp cloth. Never use scouring or sand-containing cleaning agents.

6 Maintenance and decommissioning [specialist]

Before maintaining and decommissioning the product, you must read and observe the following safety instructions:

WARNING

Risk of electric shock!



- Disconnect all electrical devices in the solar circuit from the power supply before carrying out maintenance work or decommissioning!
- Secure the electrical devices against being switched on again.

WARNING

Risk of burns and scalding!




The valves and fittings may heat up to more than 212 °F (100 °C). During maintenance or decommissioning, the solar fluid may escape as vapor and result in scalding!

- Flush and fill the system only if the collector temperatures are below 122 °F (50 °C).
- Wait until the solar fluid has cooled down to 122 °F (50 °C).

6.1 Partial draining of the solar installation [specialist]

Partial draining allows components in the station below the ball valves [5.2|1.2], for example the pump, to be replaced.

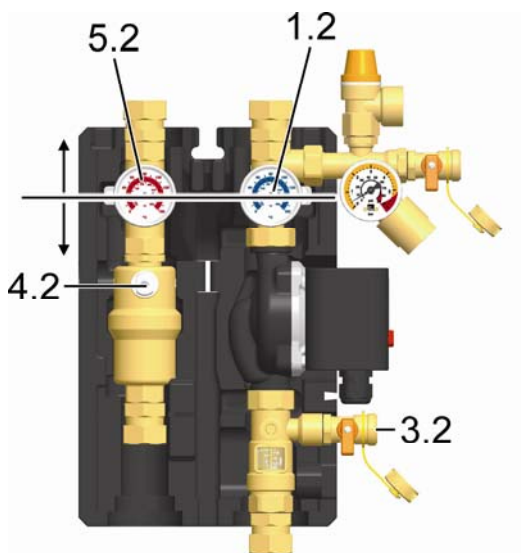

1. Disconnect the controller from the power supply and secure it against being switched on again.
2. Close the ball valves in the supply and return ball valve [5.2|1.2] by rotating them to the 90° position (90°, see page 12).
3. Connect a heat-resistant hose to the drain valve [3.2]. Make sure that the solar fluid is collected in a heat-resistant container.

⚠ WARNING

Danger of scalding due to hot solar fluid!



The escaping solar fluid can be very hot.

- Position and secure the heat-resistant collecting container such that persons nearby and the environment are not put at risk when the solar thermal system is drained.


4. Open the drain valve [3.2].
5. Carefully open the vent plug at the airstop [4.2] and close it again (see page 13).

6.2 Complete draining of the solar installation [specialist]

Complete draining enables replacement of the solar fluid, dismounting of the solar station and replacement of seals above the ball valves [5.2|1.2].


1. Perform partial draining as described above.
2. Open the check valves in the supply and return ball valves [5.2|1.2] by rotating them to the 45° position (45°, see page 12).
3. To accelerate draining of the solar circuit, you can open the bleeding device, if present, at the highest point of the solar thermal system.
4. Dispose of the solar fluid observing the local regulations.

6.3 Replacing the pump [specialist]

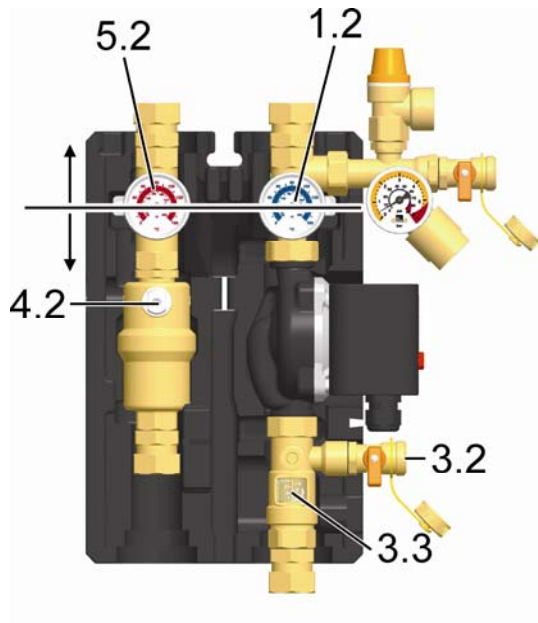

1. Perform partial draining as described in **6.1 Partial draining of the solar installation [specialist]**.
2. Disconnect the pipe joint between the solar station and the storage supply.
3. Dismount the flowmeter [3.3].
4. Dismount the pump.
5. Install the new pump. Do not forget to insert new gaskets.
6. Mount the flowmeter [3.3].
7. Connect the station and the system again by means of pipes.
8. Check all screw connections and retighten them, if necessary.
9. Open the ball valves [5.2|1.2].
10. If the system pressure no longer corresponds to the operating pressure, repeat commissioning as described from page 11 onward.

6.4 Replacing the gaskets in the solar station [specialist]

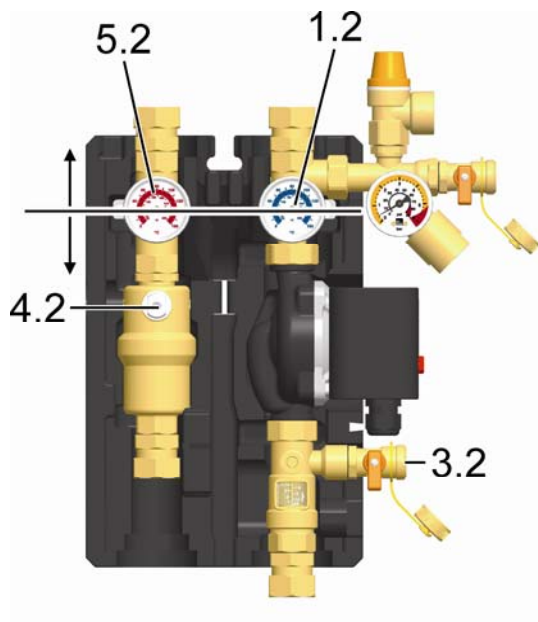

1. Gaskets below the ball valves: Perform partial draining as described in **6.1 Partial draining of the solar installation [specialist]**.
Gaskets above the ball valves: Drain the solar thermal system completely as described in **6.2 Complete draining of the solar installation [specialist]**.
2. Dismount individual components of the station and insert new gaskets.
3. Re-assemble the station.
4. Connect the station and the system by means of pipes.
5. Check all screw connections and retighten them, if necessary.
6. Open the ball valves [5.2|1.2].
7. If the system pressure no longer corresponds to the operating pressure, repeat commissioning as described from page 11 onward.

6.5 Dismounting [specialist]



1. Drain the solar thermal system completely as described in **6.2 Complete draining of the solar installation [specialist]**.
2. Disconnect the pipe joints with the solar thermal system.
3. To remove the solar station from the support, pull out the clip springs sideways using a screwdriver.
4. Pull out the station towards the front.

7 Application range of the check valves [specialist]

Within their application range, the two check valves in the solar station prevent unwanted gravity circulation.


The efficiency of the check valves depends on:

- the installation height
- the temperature difference between the storage tank and the collector
- the type of heat transfer medium

In the diagram below you can see whether the check valves integrated in the stations are sufficient. If the check valves are not sufficient, you need to install additional components to prevent gravity circulation. You can mount components such as syphons ("heat traps"), 2-way valves (zone valves) or additional check valves.

Example:

- You would like to install a FlowCon solar station. The station comprises two check valves, 2 x 7.9 inch head = 15.8 inch head (2 x 200 mm wc = 400 mm wc).
- You use a mixture of water and 40% of propylene glycol as a solar fluid.
- The installation height between the collector and the storage tank is ~33 ft (10 m).

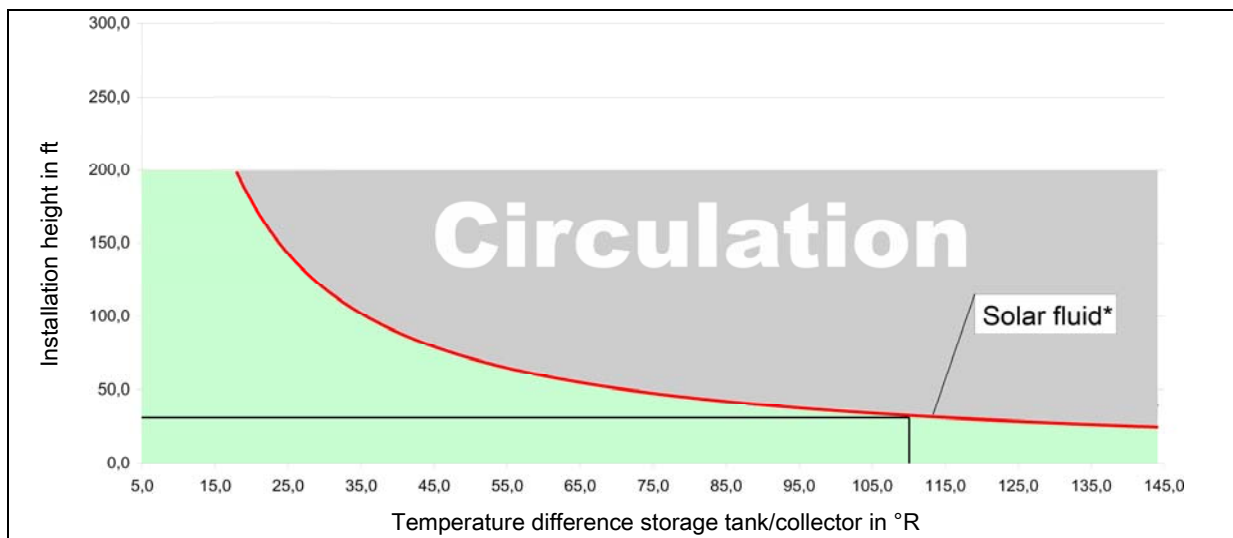

Result:

The check valves prevent gravity circulation up to a temperature difference of **about 112 °R**

(~62 K). If the temperature difference between the collector and the tank is larger, the difference in density of the solar fluid will be so large, that the check valves are pushed open.

* solar fluid = mixture of water and 40% of propylene glycol



Do you need to know it exactly?

The density of the solar fluid decreases with rising temperature. In high installations with large temperature differences, the difference in density will cause gravity circulation. This circulation can cool down the storage tank.

Calculation example: $\Delta P = \Delta \rho \cdot g \cdot h$

Collector temperature: 41 °F (5 °C) → Density solar fluid $\rho_1 = 1042 \text{ kg/m}^3$

Storage tank temperature: 153 °F (~67 °C) → Density solar fluid $\rho_2 = 1002.5 \text{ kg/m}^3$

$$\Delta \rho = \rho_1 - \rho_2 = 39.5 \text{ kg/m}^3$$

$$g = 9.81 \text{ m/s}^2$$


Installation height $h = 33 \text{ ft (10 m)}$

$$\Delta P = 3875 \text{ Pa} = 395 \text{ mm wc} \approx 15.6 \text{ inch head}$$

The two check valves (400 mm wc ≈ 15.8 inch head) are sufficient for an installation height of 33 ft (10 m) and a temperature difference between the collector and the tank of up to 112 °R (~ 62 K).

8 Spare parts [specialist]


In the event of a complaint, please fill in completely the commissioning log on page 27 and send it back to us.

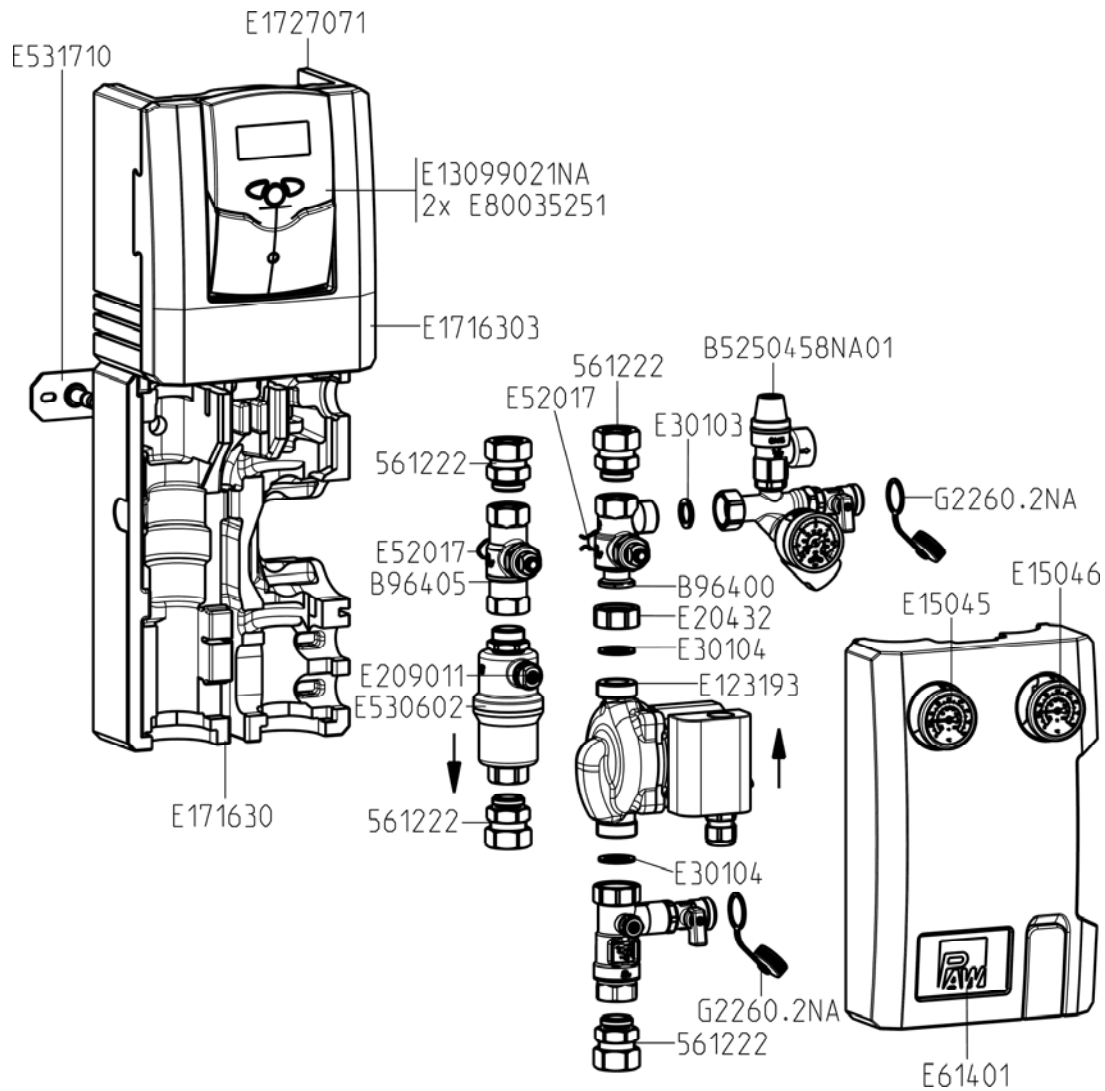


		Scale	Article number
Flowmeter		Imperial: 0.8 – 6 Usqpm	B5040085US
		Metric: 3 - 22 l/min	B5040085NA

9 Technical data and pressure drop characteristic

Dimensions:	Total height (without controller)	15.9" / 405 mm
	Total height (with controller)	23" / 585 mm
	Total width	12" / 305 mm
	Depth	5.9" / 150 mm
	Center distance supply/return	3.94" / 100 mm
	Pipe connections	3/4" cutting-ring compression fitting
	Connection for the expansion tank	3/4" female thread, NPT
	Outlet of pressure relief valve	3/4" female thread
Operating data:	Max. admissible pressure	PN 10
	Max. operating temperature	248 °F / 120 °C
	Short-term load	320 °F / 160 °C < 15 minutes
	Max. propylene glycol content	50 %
Equipment:	Pressure relief valve	87 psi / 6 bar
	Pressure gauge	0-87 psi / 0-6 bar
	Check valves	2 x 7.9 inch head / 2 x 200 mmWC, can be opened
	Flowmeter	0.8 - 6 Usgpm or 3 - 22 l/min
Material:	Valves and fittings	Brass
	Gaskets	EPDM
	Check valves	Brass
	Insulation	EPP, $\lambda = 0.043 \text{ W/(m K)}$

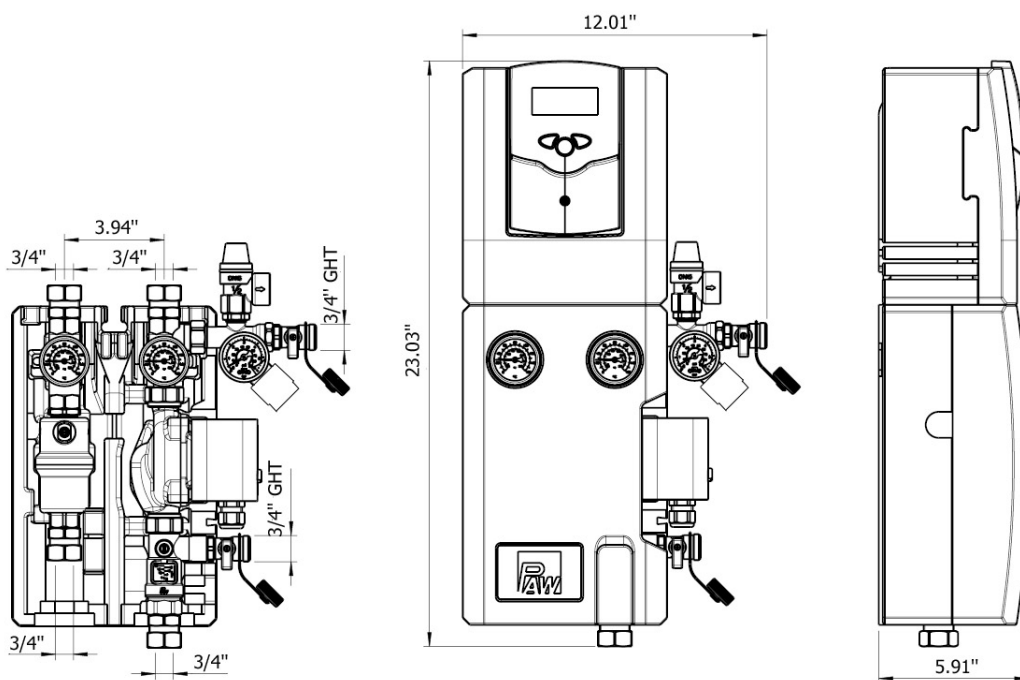


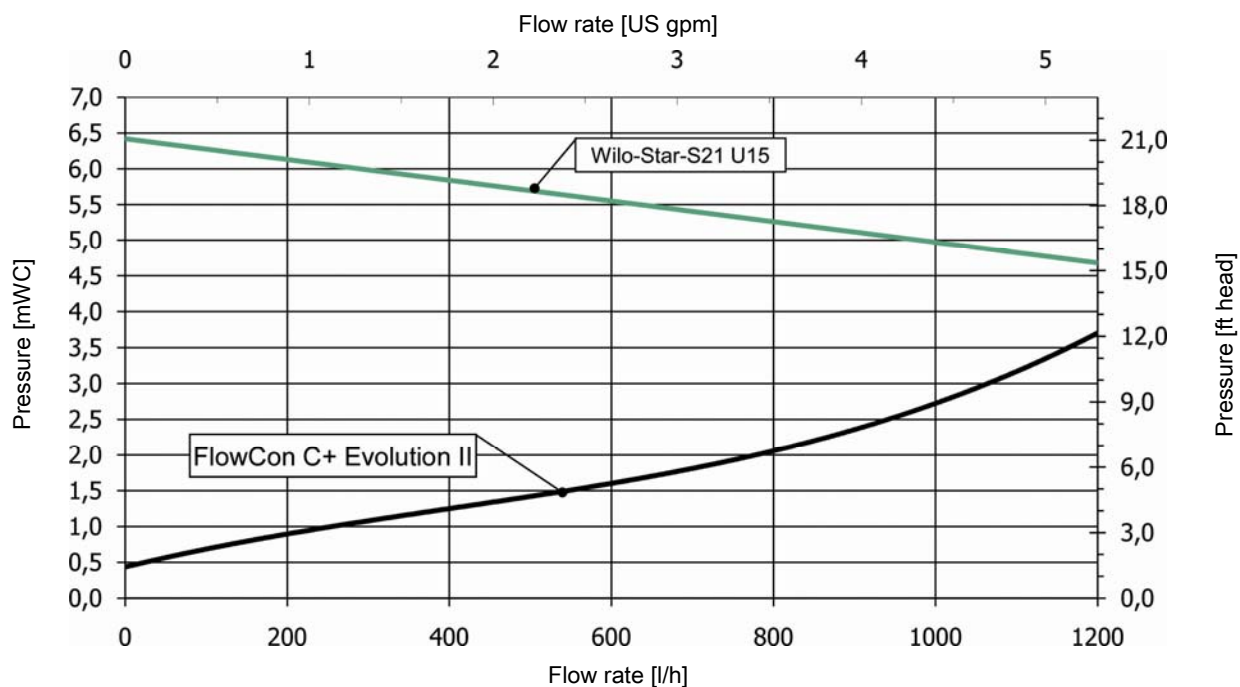



10 Commissioning log

System operator			
Installation site			
Collectors (number / type)			
Collector surface area		m ²	
System height		m	(Height difference between station and collector field)
Pipeline	ø =	mm	l = m
Ventilation (collector field)	☐ Manual bleeder ☐ Automatic bleeder ☐ No ☐ Vented		
Airstop (station)	☐ Vented		
Solar fluid (type)			
Antifreeze (checked up to):		°C	% of glycol
Flow rate		l/m	
Pump (type)			
Pump stage (I, II, III)			
System pressure		mbar	
Expansion tank (type)			
Initial pressure		mbar	
Pressure relief valve	☐	Checked	
Check valves	☐	Checked	

Serial numbers	
Station	
Controller	
Software version	
Flow-rate-reducing position	

Installation company	Date, Signature

		Submittal Data Information Solar station FlowCon C+ Evolution II		7655219 WS7xx
Version: 02		Effective: August 1st, 2011		Supersedes: May 1st, 2011
Job: _____	Engineer: _____	Contractor: _____	Rep: _____	
ITEM NO.		MODEL NO.		

Features:

Delta Sol BS Plus differential temperature controller

All medium-carrying parts are made of brass

3/4" connections, compression fitting

Fully pre-assembled on steel wall support, quick and easy to mount on the wall due to stable snap-lock technology


Two ball valves with brass check valves (7.9 inch head / 200 mmWC) and spindle exchangeable under pressure

All-metal temperature gauges integrated into the ball valve with immersion sleeve

Flowmeter 0.8-6 Usgpm or 3-22 l/min with ball valve

Safety assembly with pressure relief valve 87 psi / 6 bar, pressure gauge and connection for expansion tank

Airstop with manual bleeding for venting the solar circuit, flush and fill valves

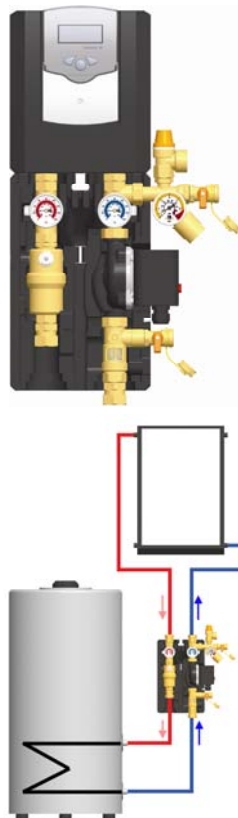


Use in closed loop design only. The solar station is used on the primary loop of solar thermal systems to control the temperature in the hot water storage tank. The pump inside the unit is activated by the signal from a differential temperature controller.

In addition, this station contains the functional and safety devices for optimum circuit control.

The components enable:

- Medium circulation with solar pump
- Safety against pressure increase
- Exact flow rate control
- Flushing, filling and draining the circuit
- Measuring the supply and return temperatures
- Deaerating the solar loop
- Shutting off the circuits
- Preventing gravity circulation
- Thermal insulation of the components

Dimensions	Total height (with controller)	23" / 585 mm
	Total width	12" / 305 mm
	Depth	5.9" / 150 mm
	Center distance, supply/return	3.94" / 100 mm
	Pipe connections	3/4" compression fitting
Operating data	Max. admissible pressure:	PN 10
	Max. operating temperature	248 °F / 120 °C
	Max. propylene glycol content	50 %
Materials	Valves and fittings	Brass
	Gaskets	EPDM
	Check valves	Brass
	Insulation	EPP, $\lambda = 0,043 \text{ W/(m K)}$

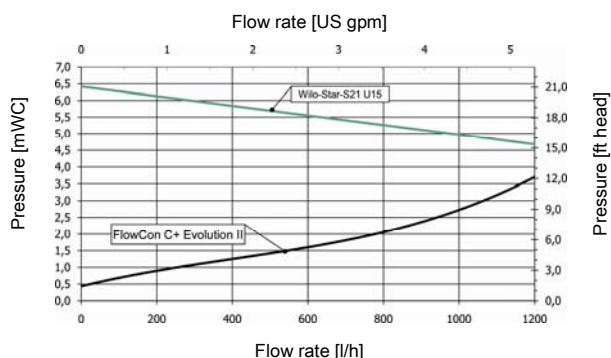

PAW products specified in Imperial or metric units are approximate and are provided for reference only. For precise measurements, please contact PAW Technical Service. PAW reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on PAW products previously or subsequently sold.

In the USA distributed by PAW NA LP, 45 Davis Street, Webster, MA 01570, Tel: +1-508-943-4240, Fax: +1-508-943-4140

Visit our website at: www.paw.eu

Art. no. 997655219WS7x – Version V04 – Issued 2011/08

Subject to technical changes.

Printed in Germany – Copyright by PAW NA Limited Partnership

PAW NA Limited Partnership

45 Davis Street

Webster, MA 01570, USA

PAW NA Limited Partnership

45 Davis Street

Webster, MA 01570, USA

www.paw.eu

Phone: +1-508-943-4240

Fax: +1-508-943-4141
