





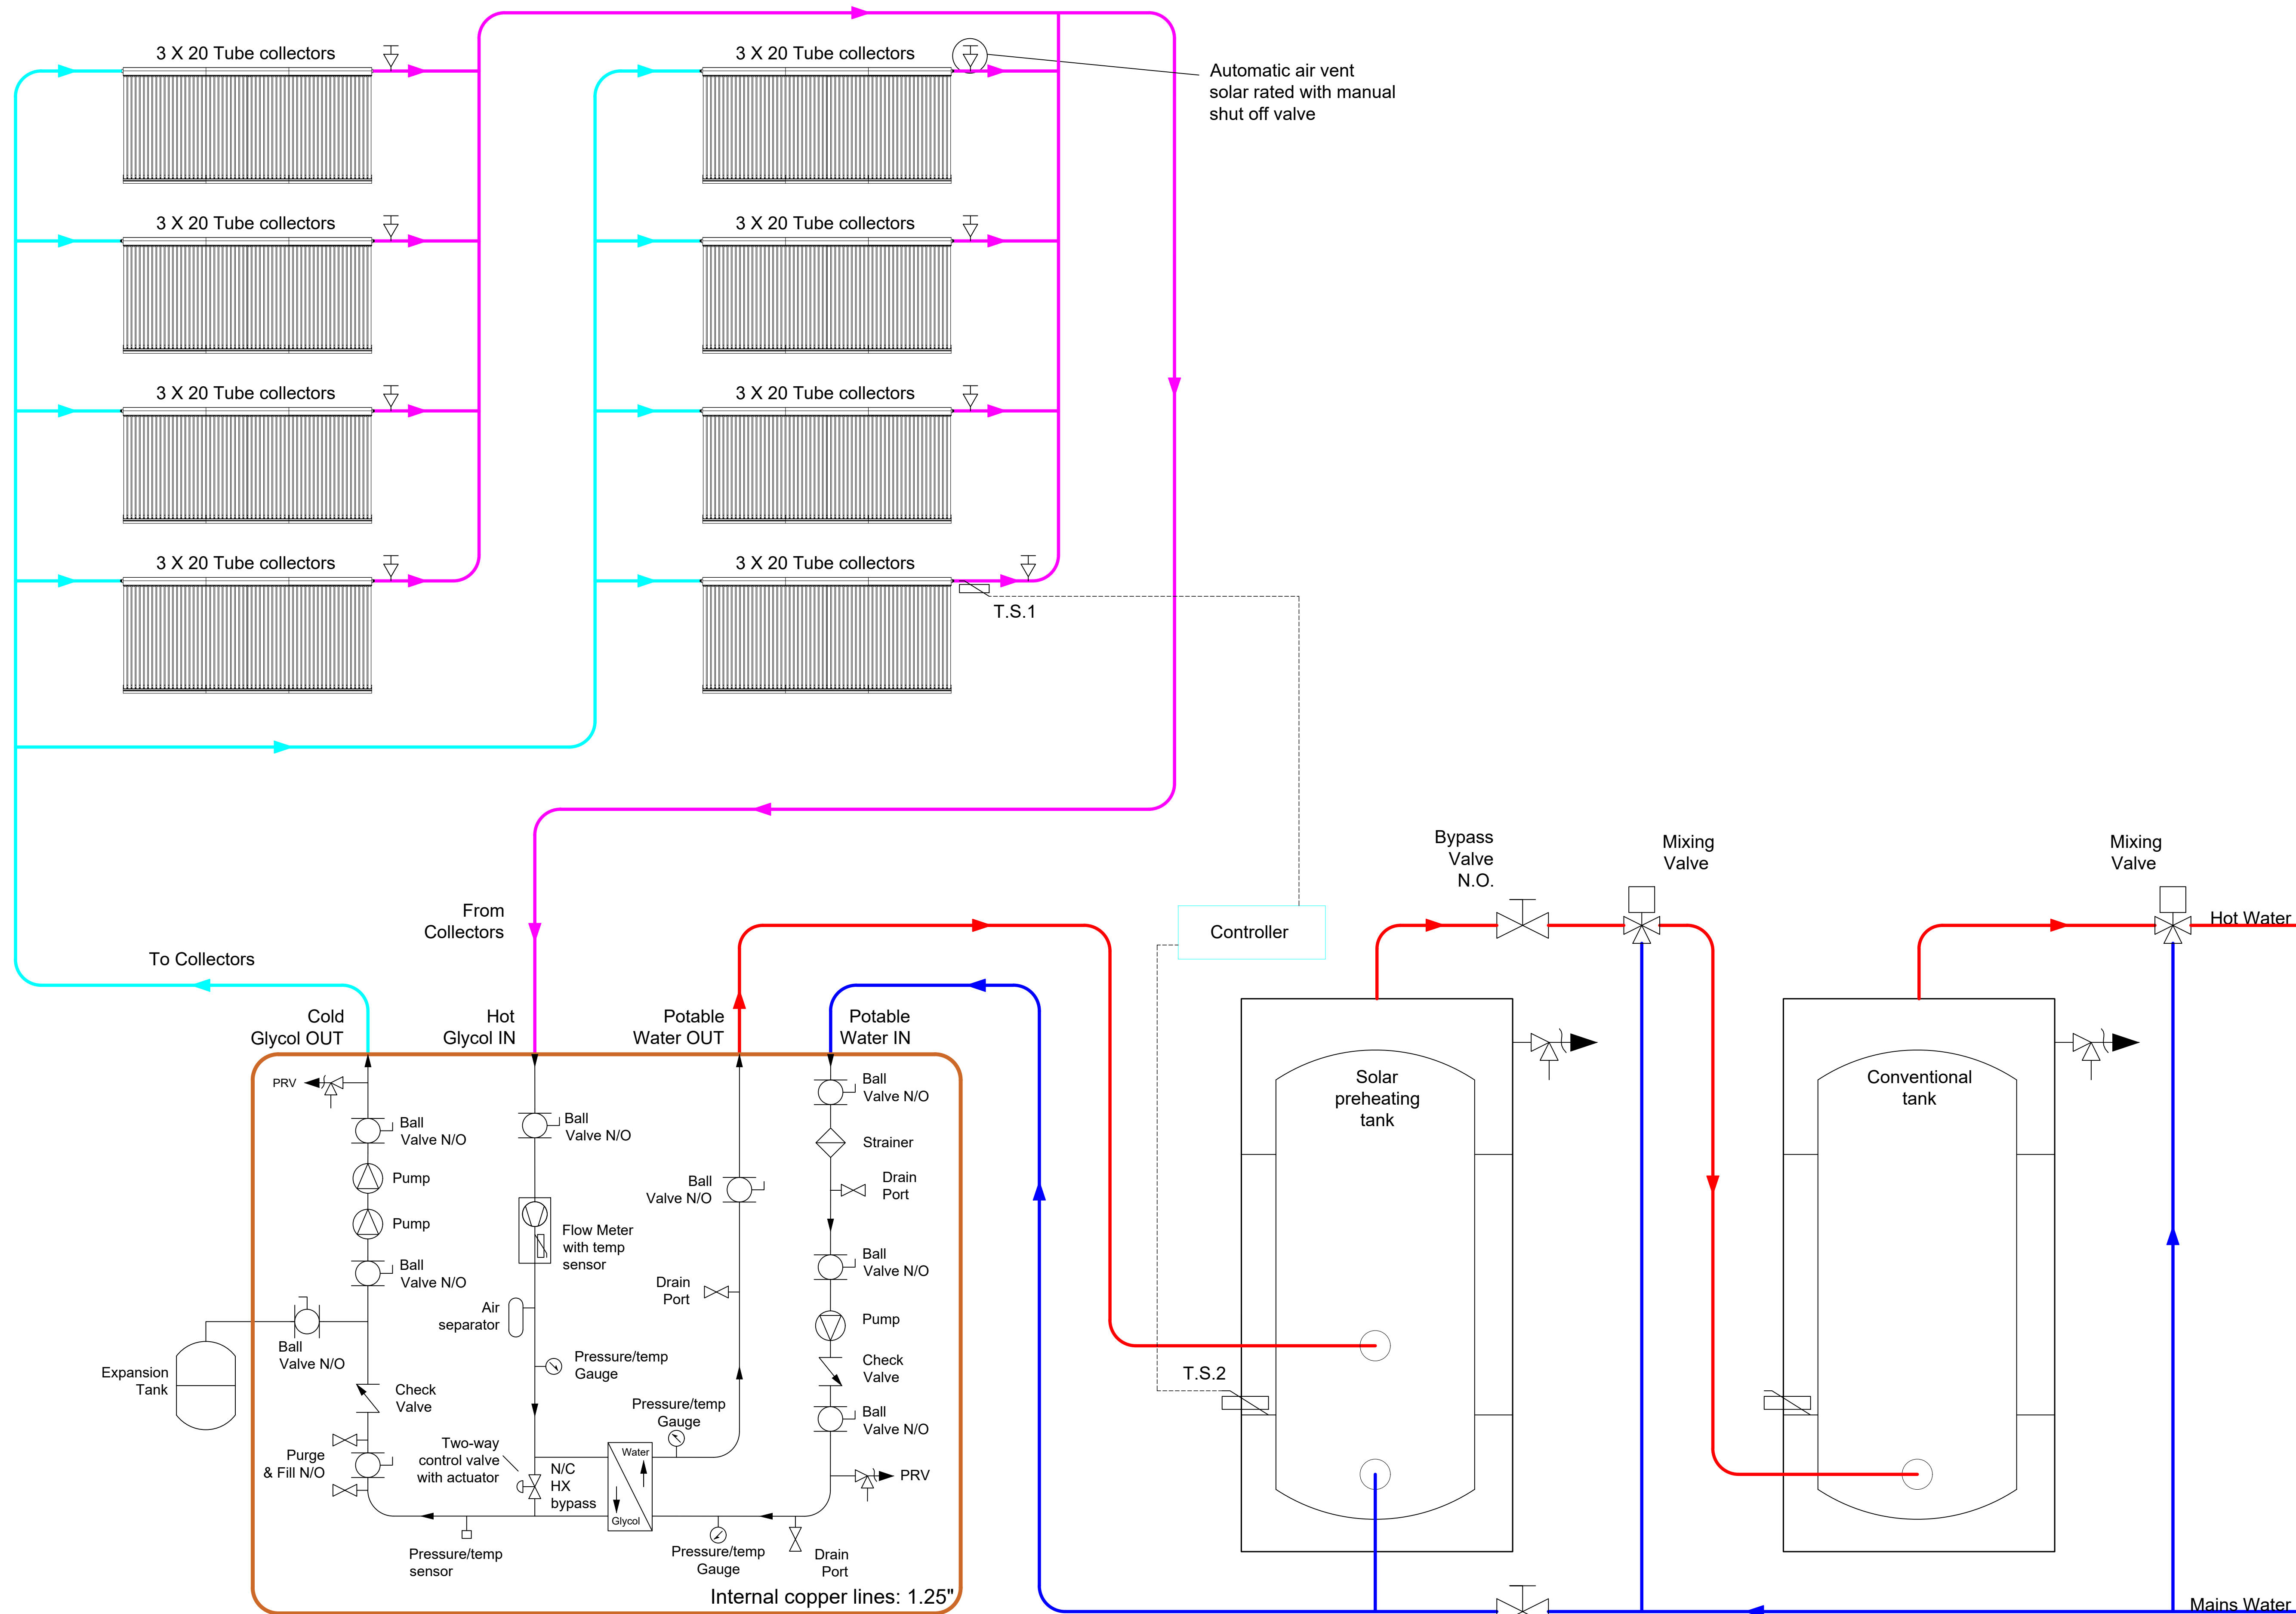


NOTE:

- Water side components are lead free. certifications are available upon request.
- The maximum charging pressure: 90 psi.

SET-1795-23-28-E1

Project Name Solar Thermal System With SET-1785-23-28-E1 Hydraulic & Electrical Schematic	
Schematic WAA062	Sheet 1
Date 4/19/2021	
Scale As Noted	

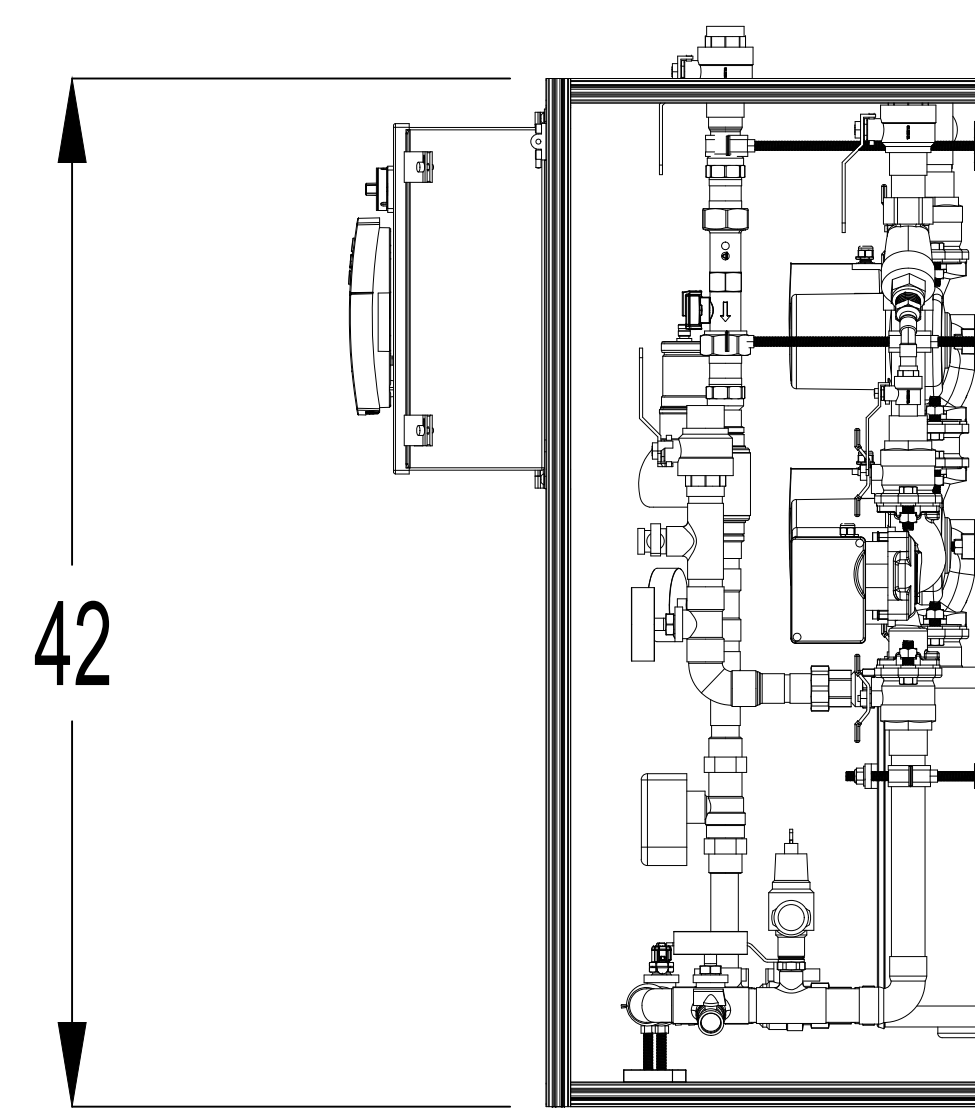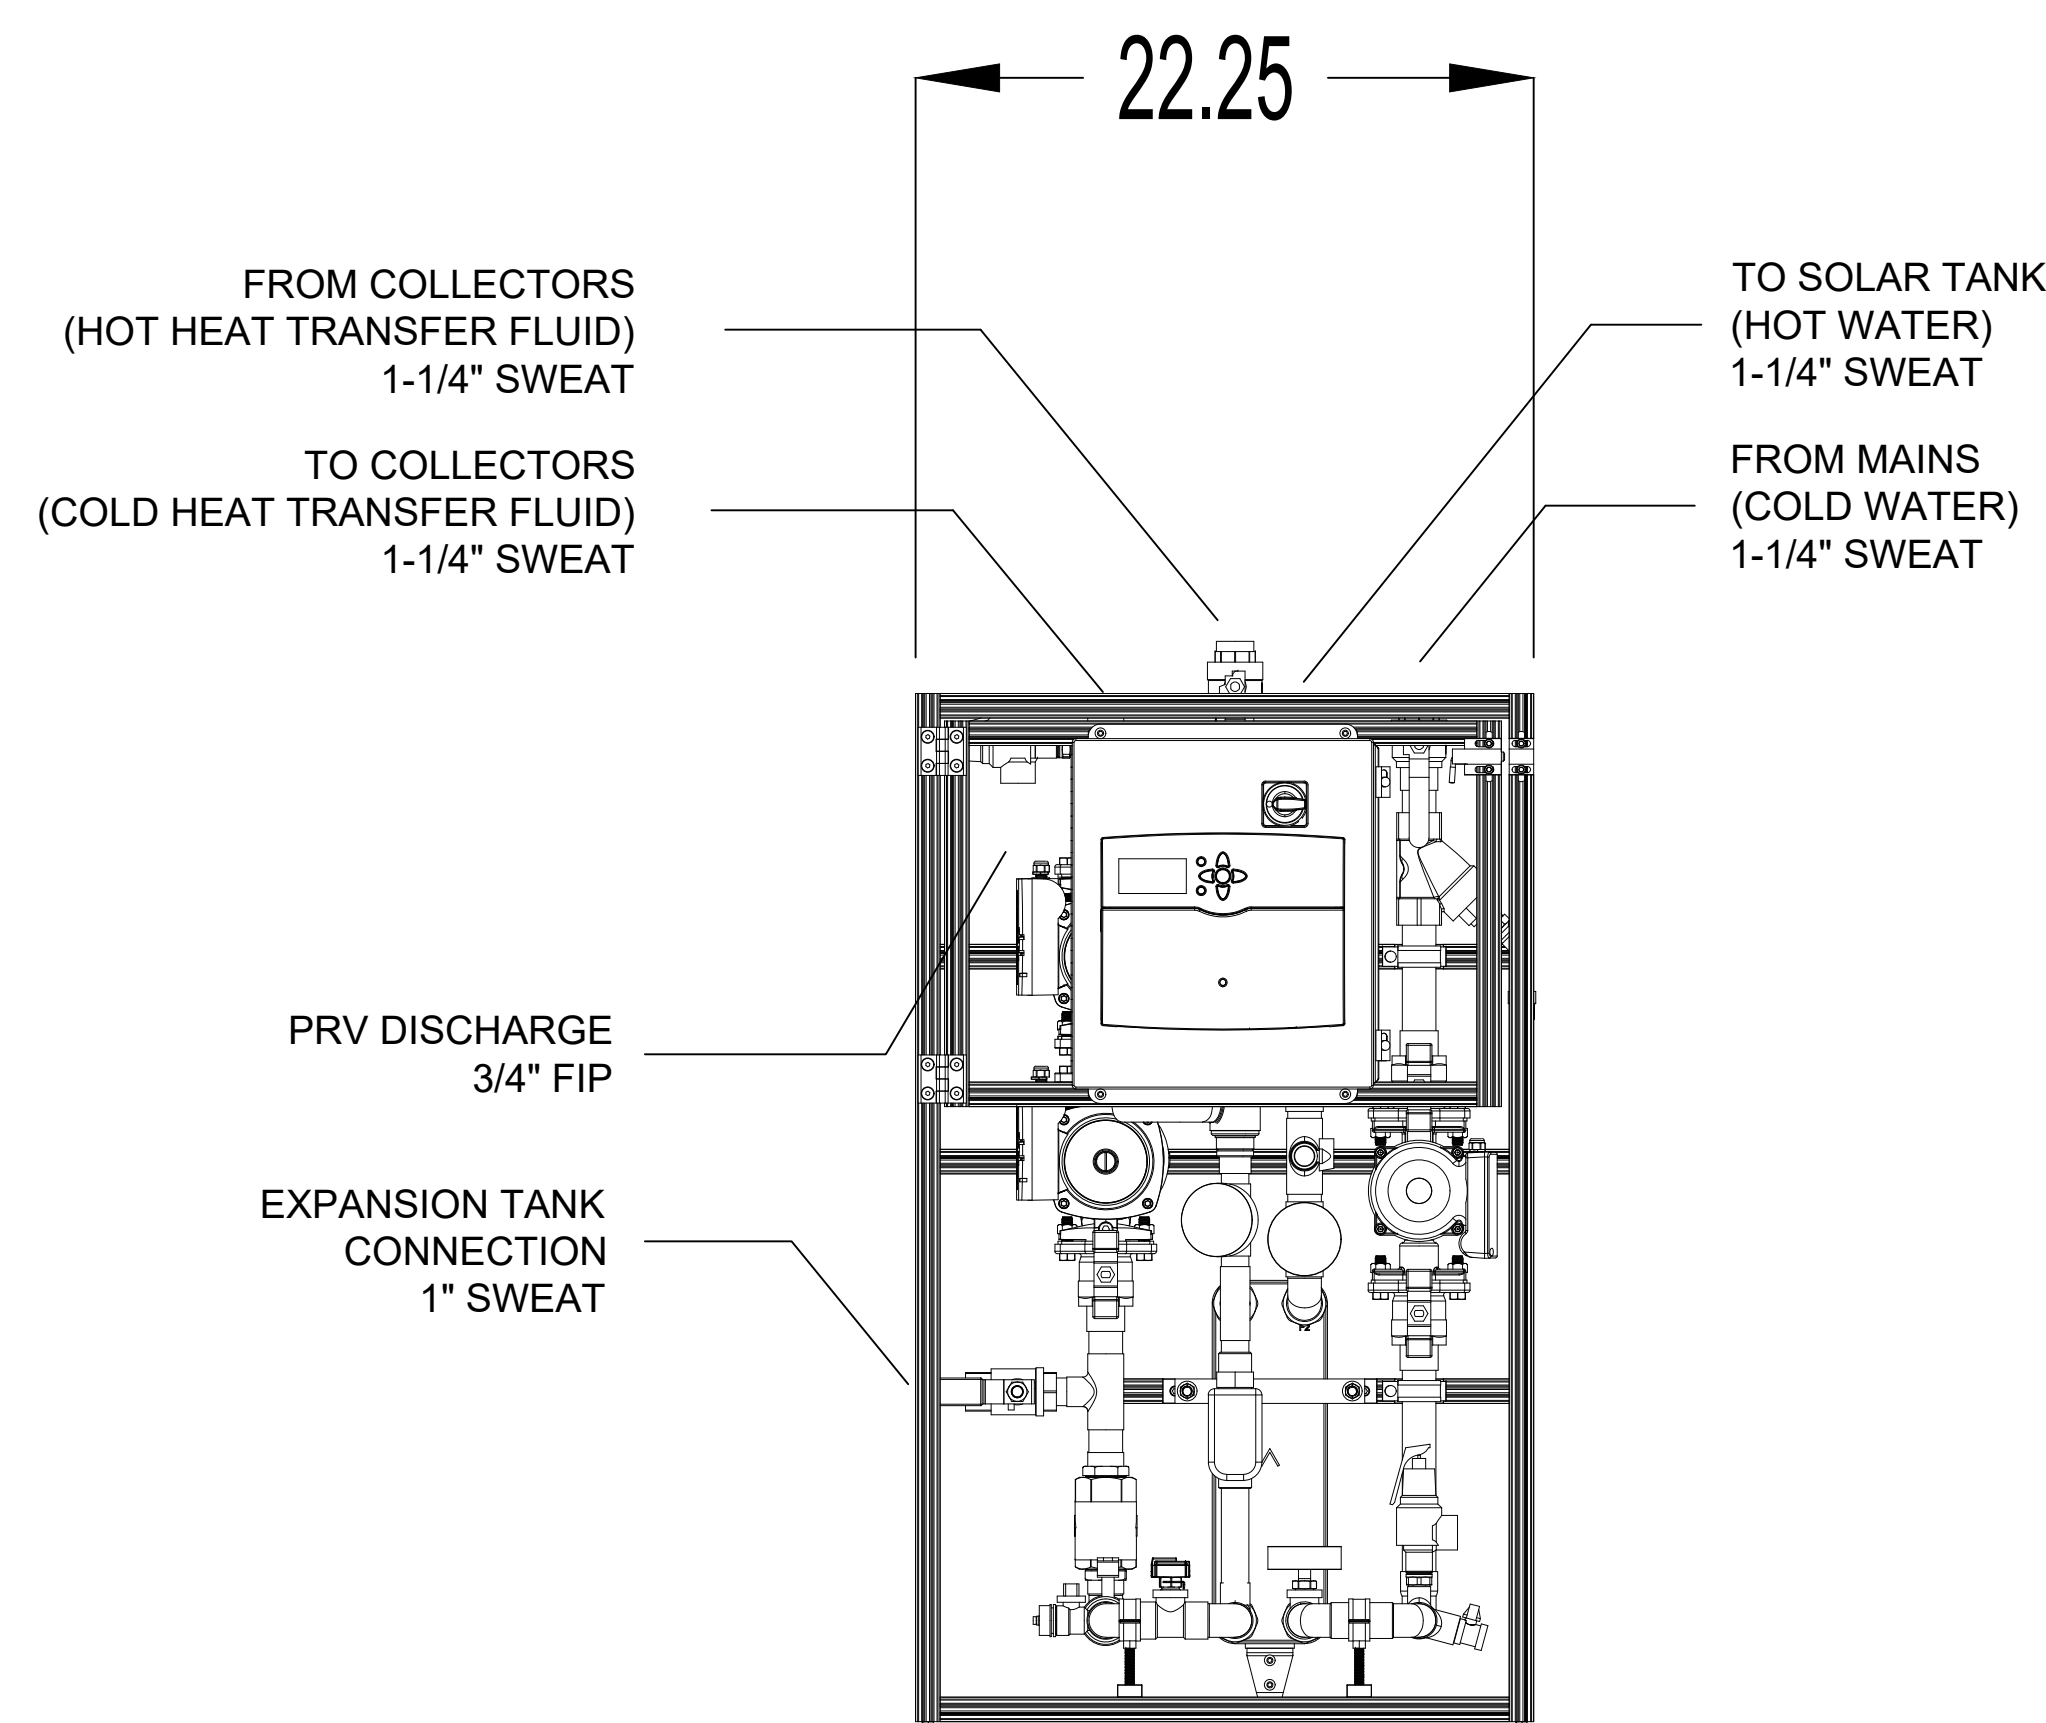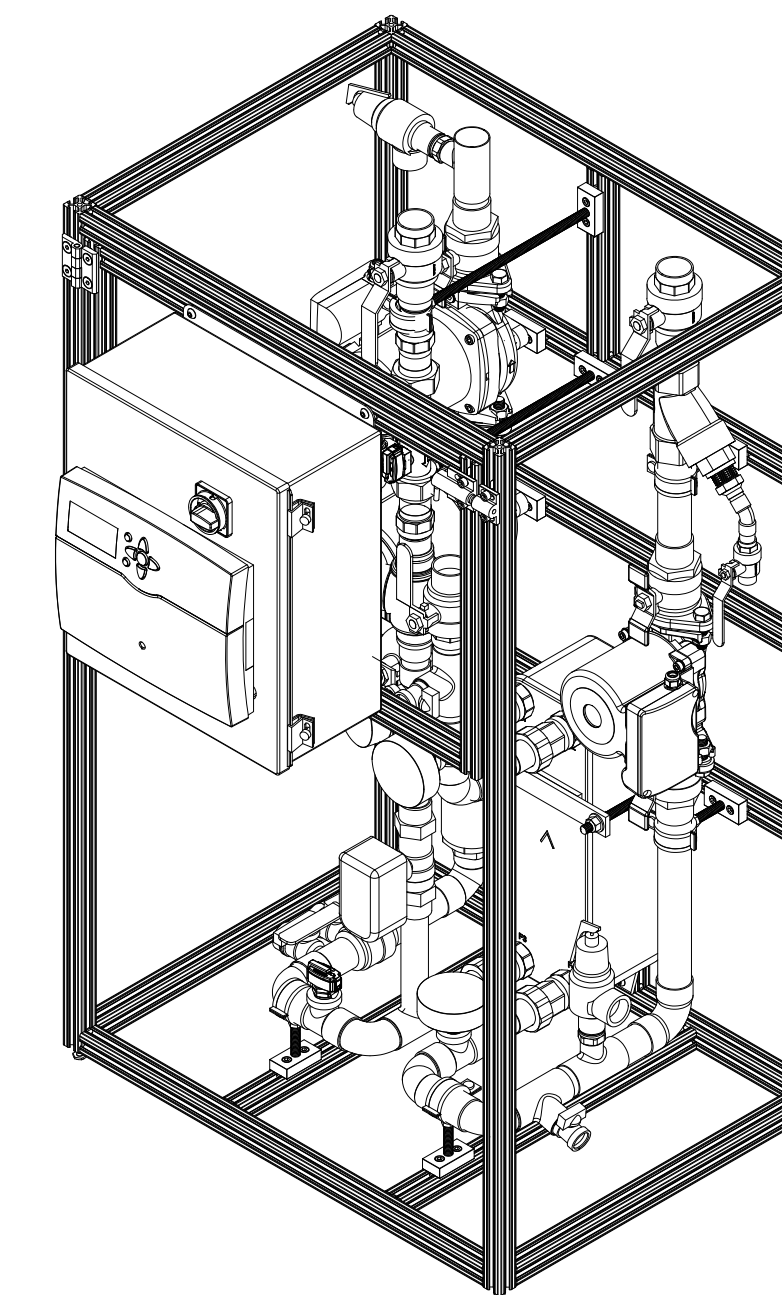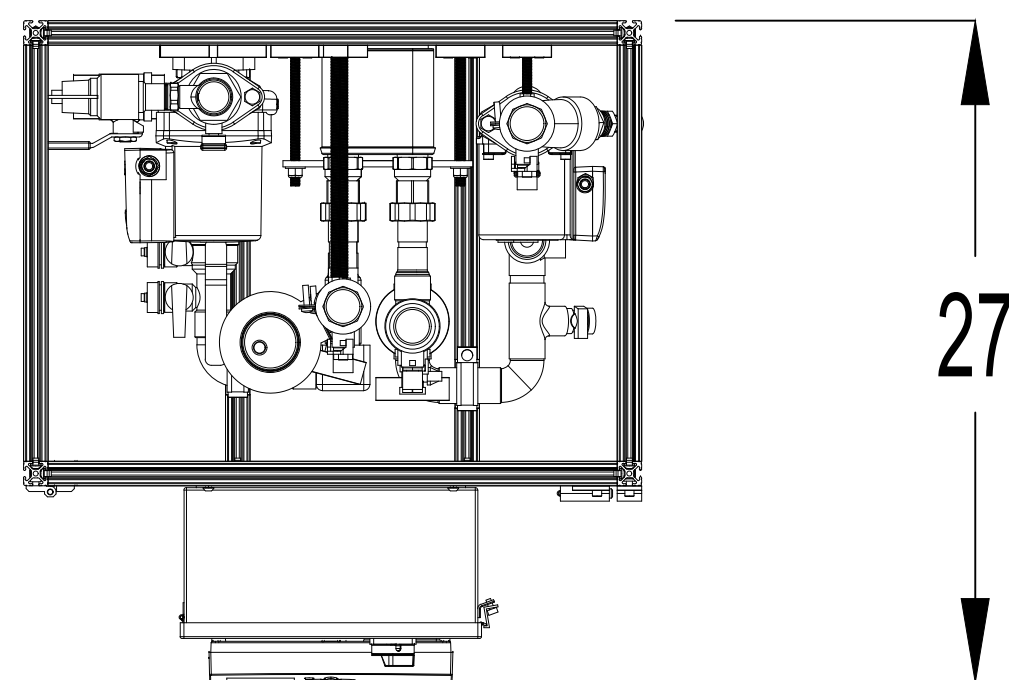

SOLAR ENERGY TERMINAL (SET)

Power Supply Table				
Energy Terminal Size	Required Voltage (VAC)	Required Current (amp)	Required (PH)	Required Frequency (HZ)
SET-1795-23-28-E1	110	11	1	60

NOTE: Energy Terminal also available in 240 VAC

Company Name

Project Name

Solar Thermal System
With SET-1785-23-28-E1
Hydraulic & Electrical Schematic

Schematic WAA062


Date 4/19/2021

Scale As Noted

Sheet

2

WIRING DIAGRAM

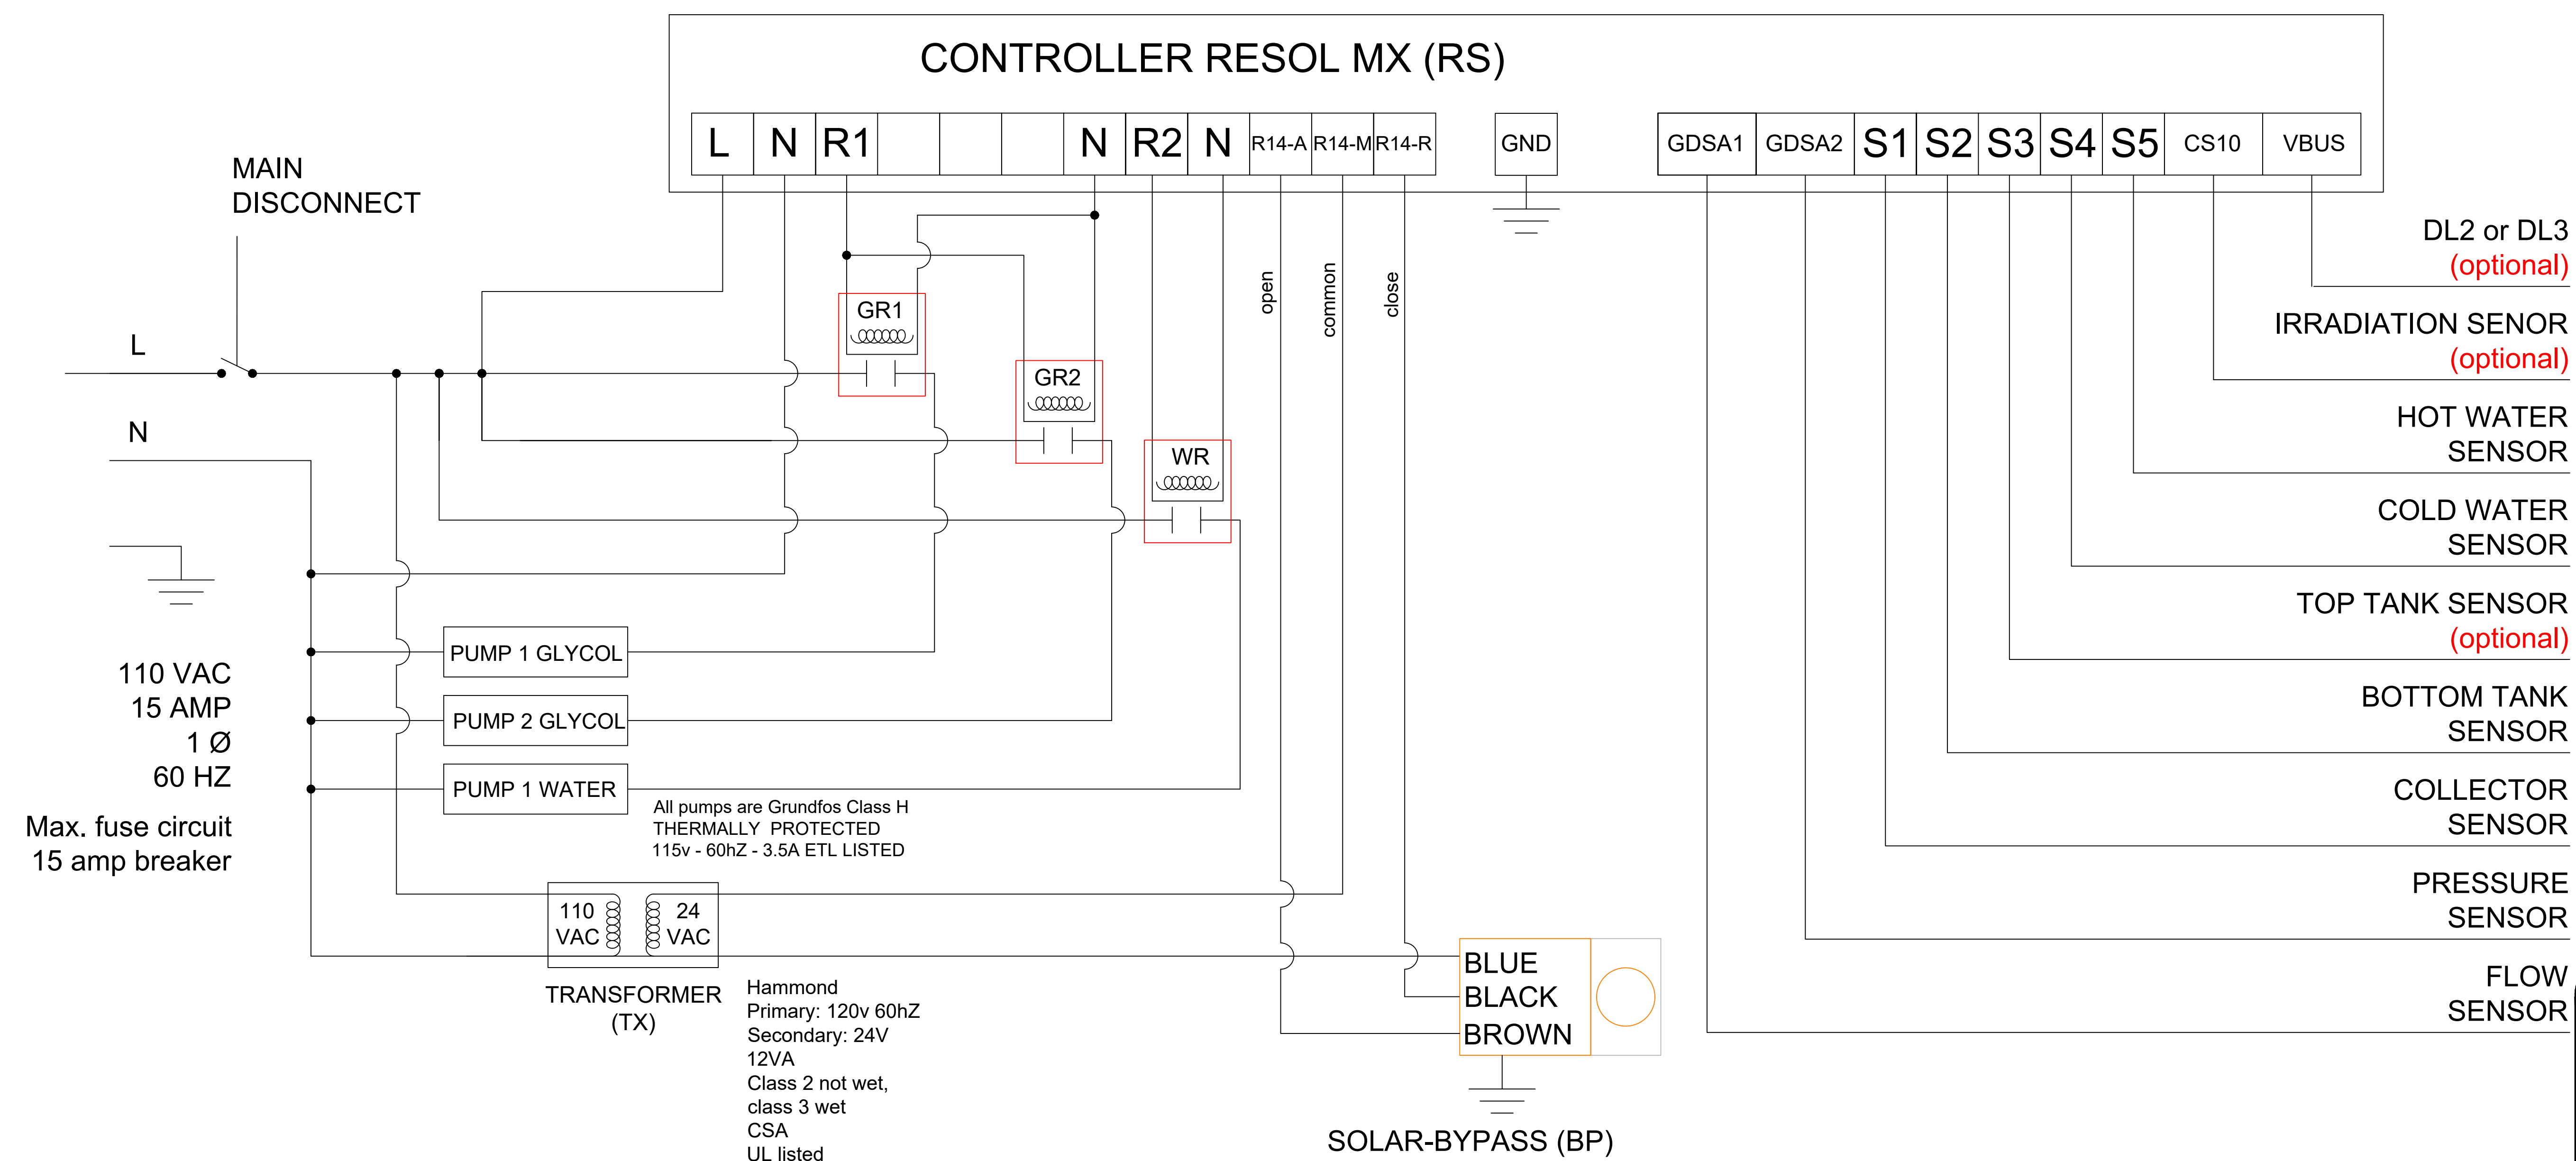

Power Supply Table

Energy Terminal Size	Required Voltage (VAC)	Required Current (amp)	Required (PH)	Required Frequency (HZ)
SET-1795-23-28-E1	110	11	1	60

NOTE: Energy Terminal also available in 240 VAC



Project Name
Solar Thermal System
With SET-1785-23-28-E1
Hydraulic & Electrical Schematic

Schematic WAA062	Sheet 3
Date 4/19/2021	
Scale As Noted	