


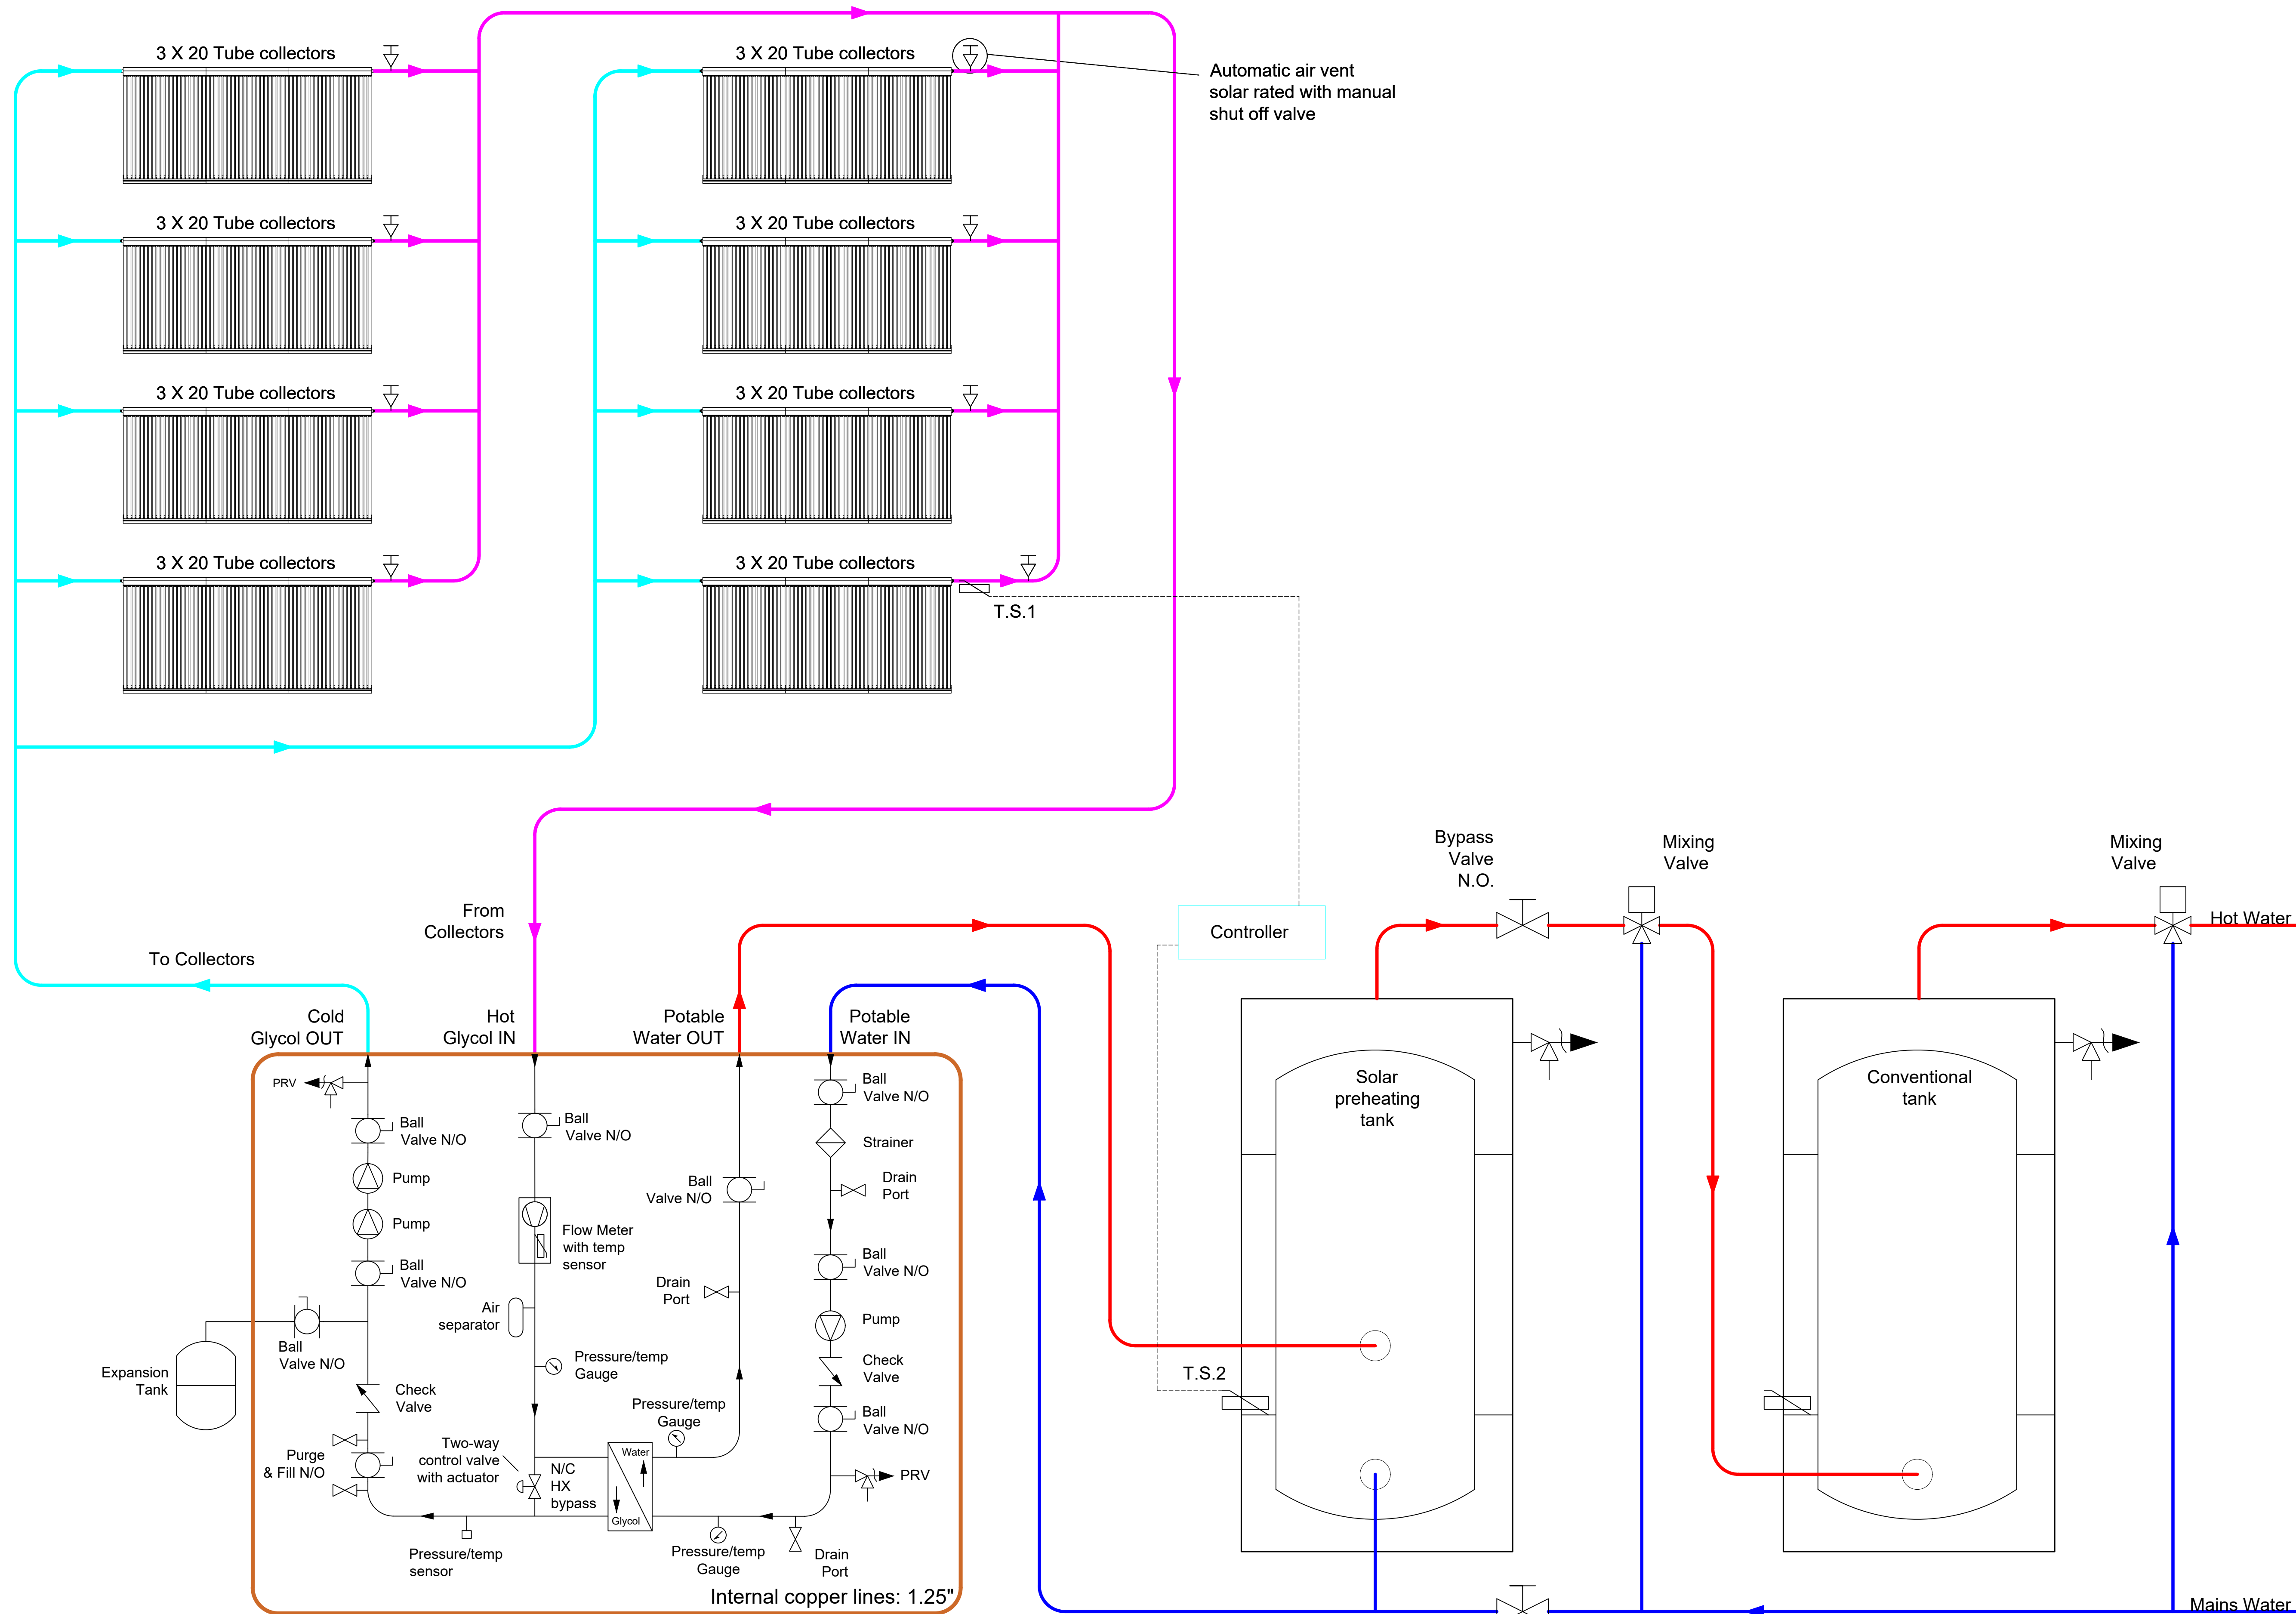


NOTE:


- Water side components are lead free. certifications are available upon request.
- The maximum charging pressure: 90 psi.

SETO-1020-13-50-E1


Project Name Solar Thermal System With SETO-1020-13-50-E1 Hydraulic & Electrical Schematic	
Schematic WAA064	Sheet 1
Date 5/6/2021	
Scale As Noted	

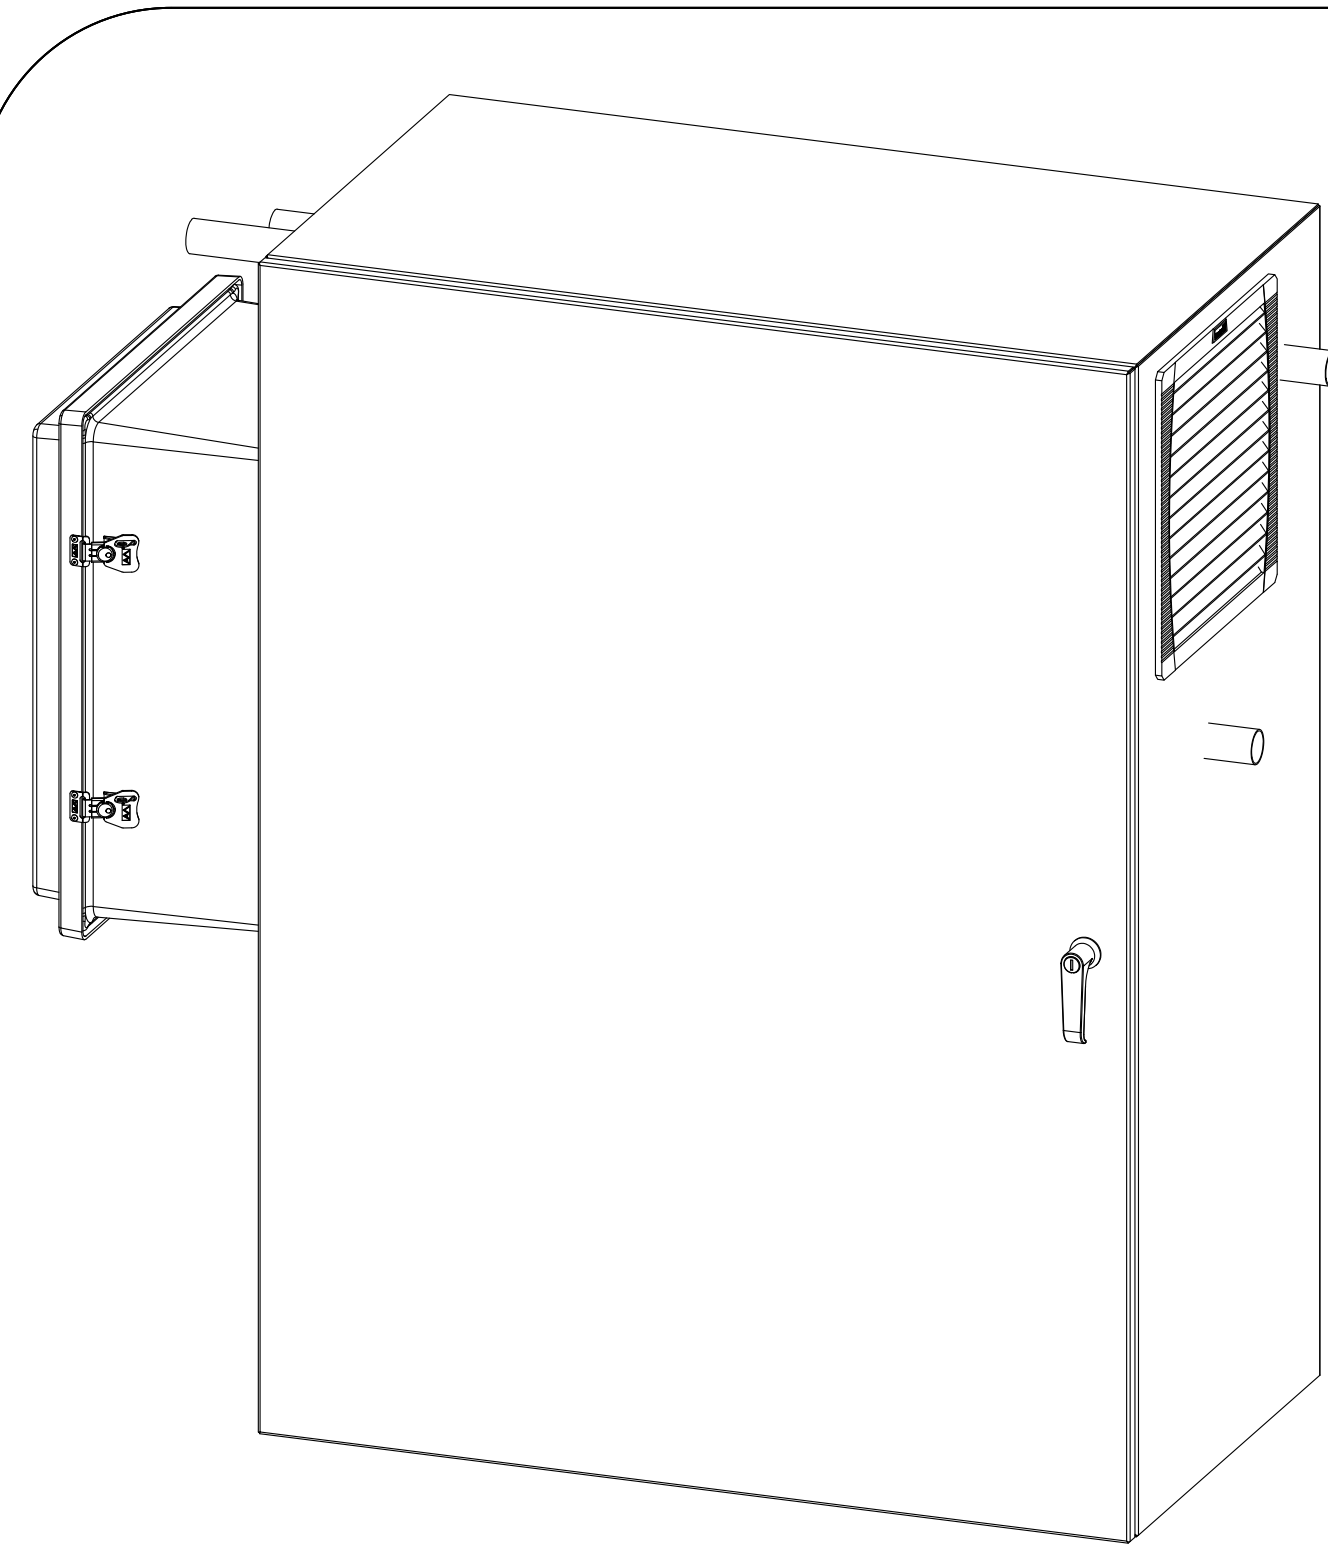



with door

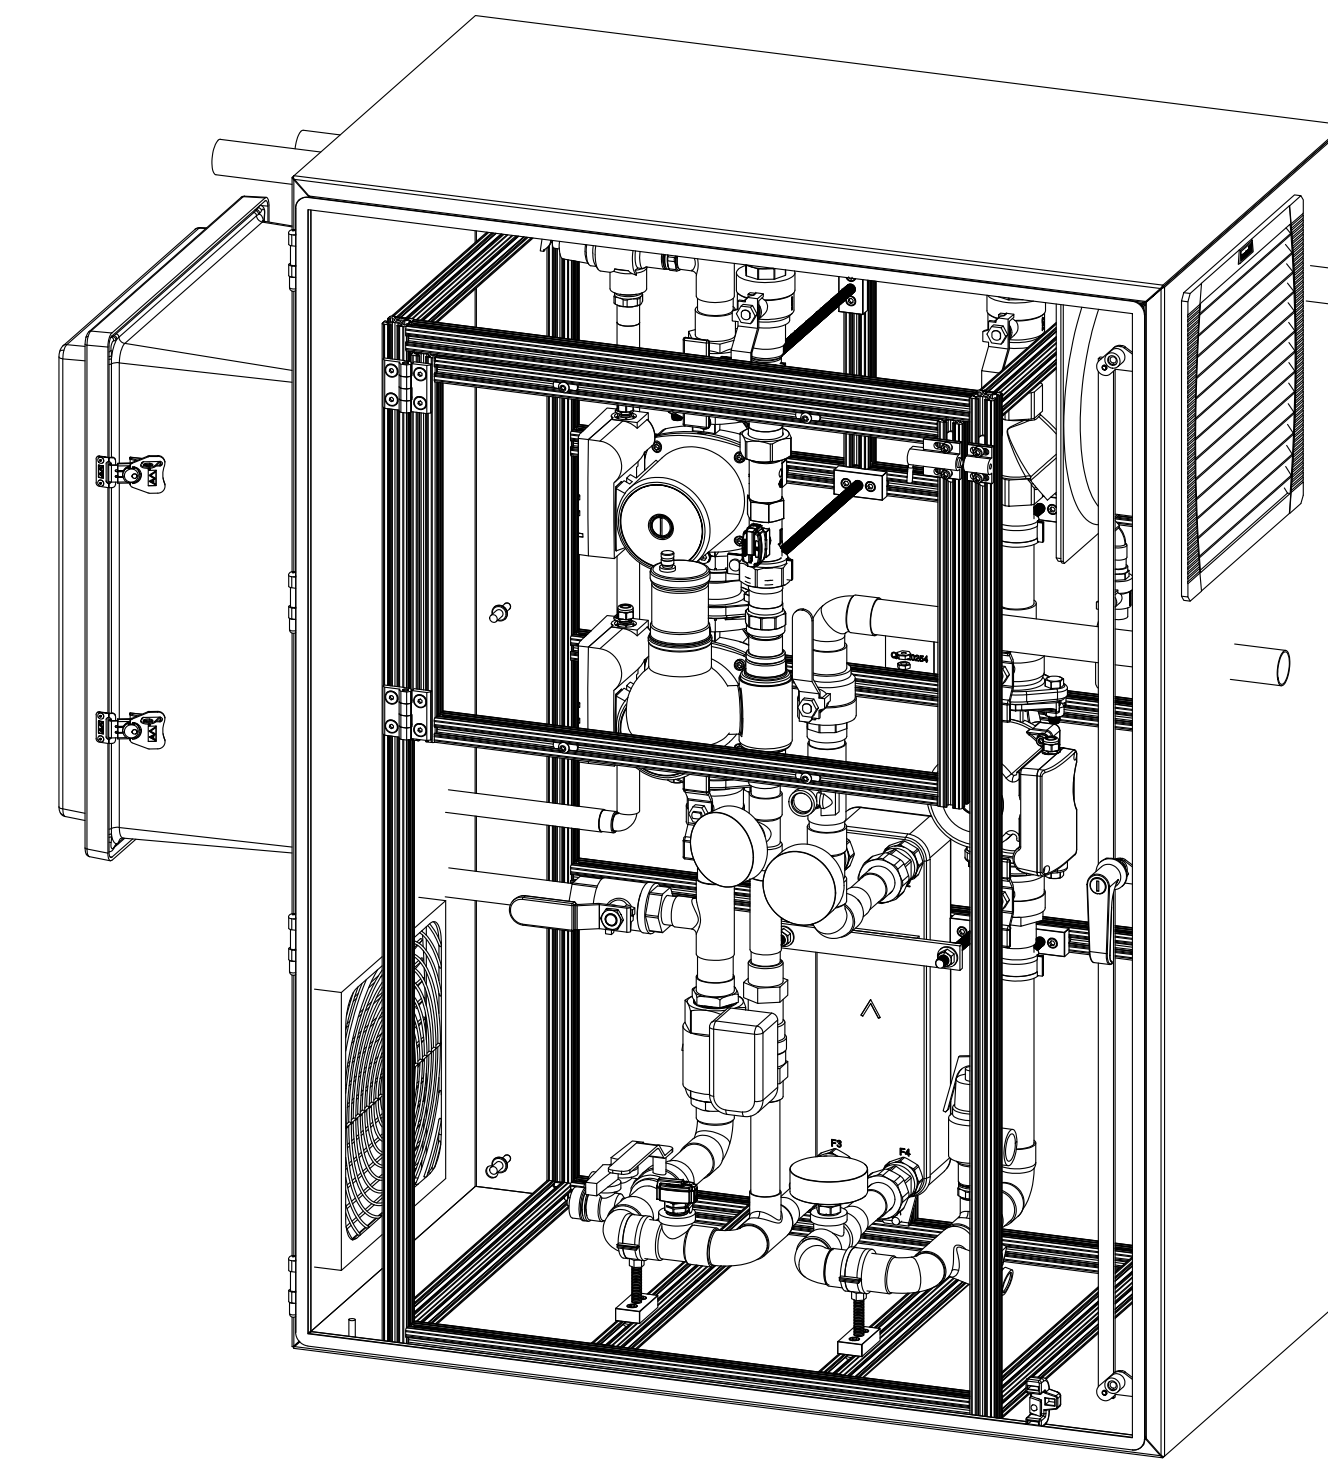

without door
(to show internal components)

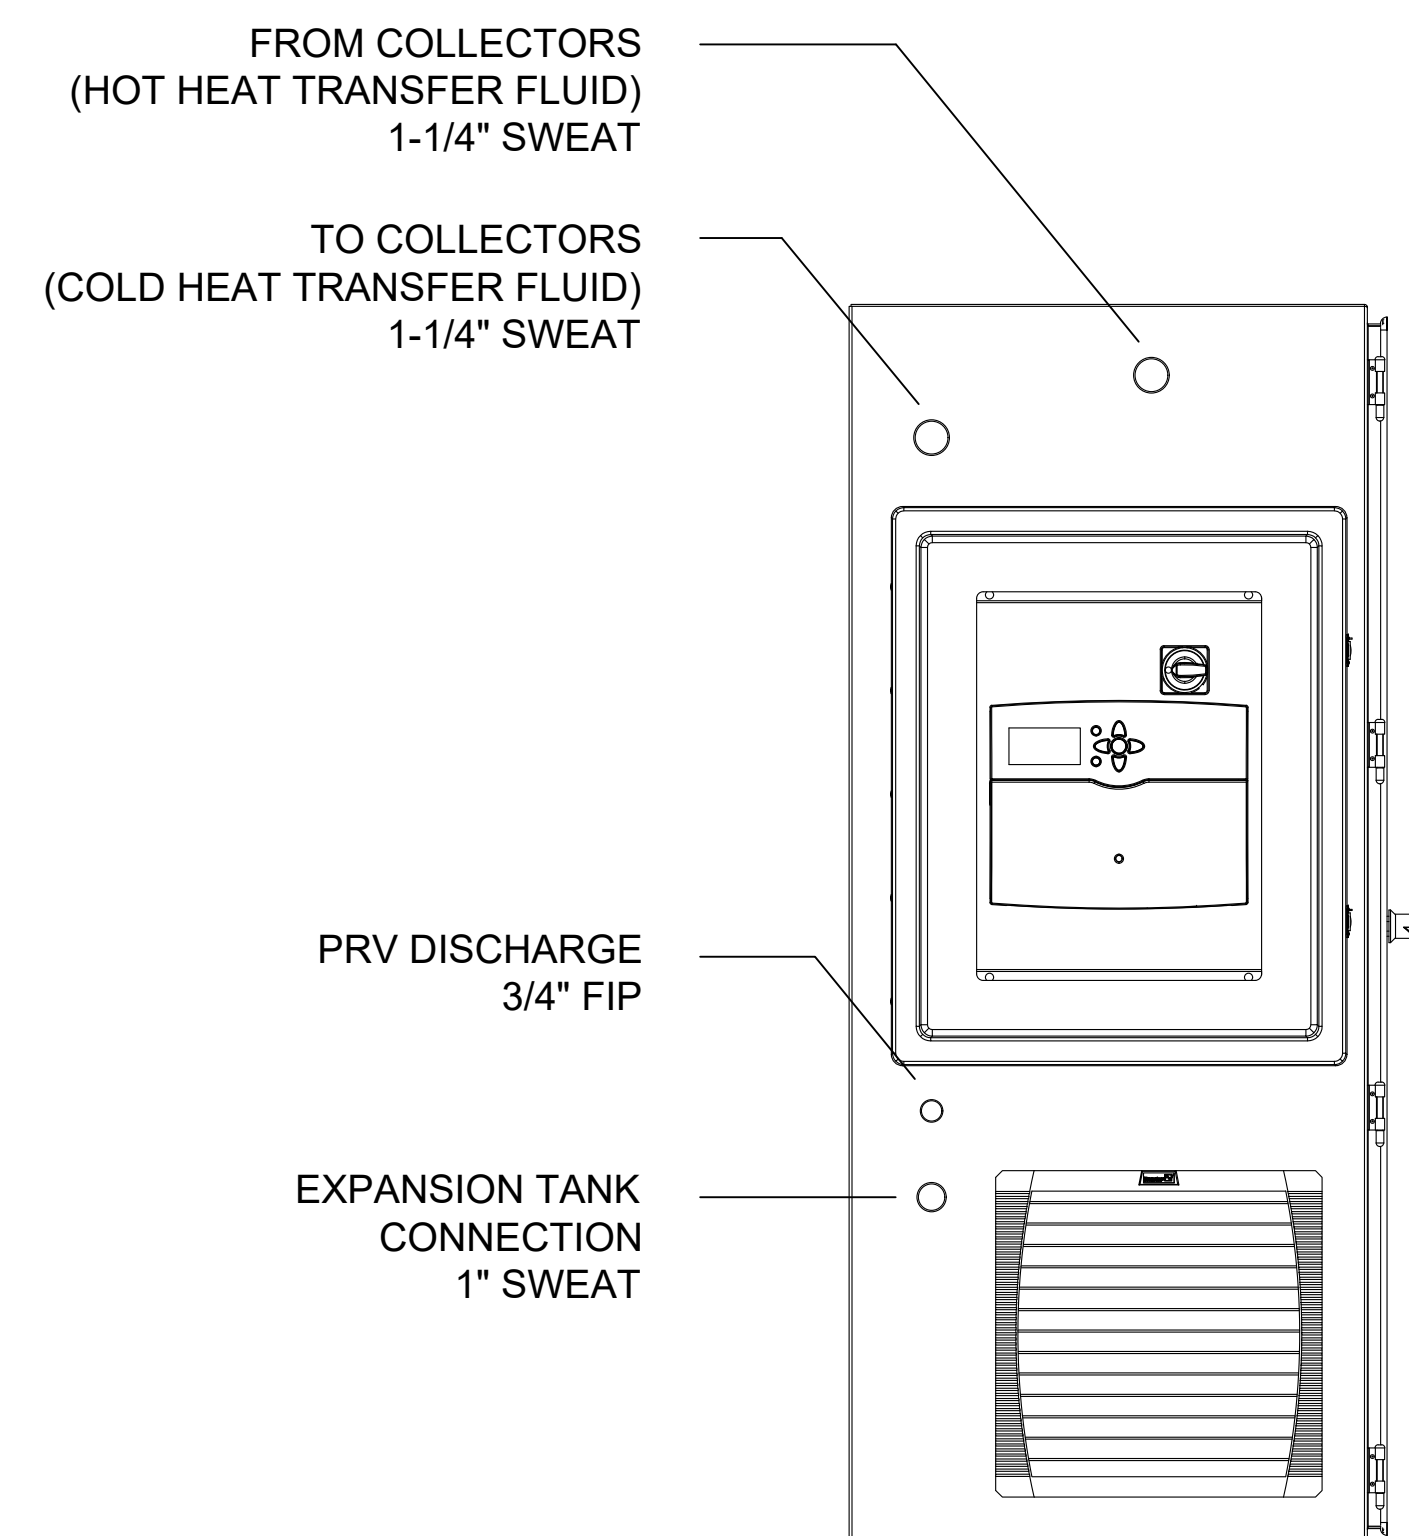

SETO-1020-13-50-E1
(without door to show internal components)

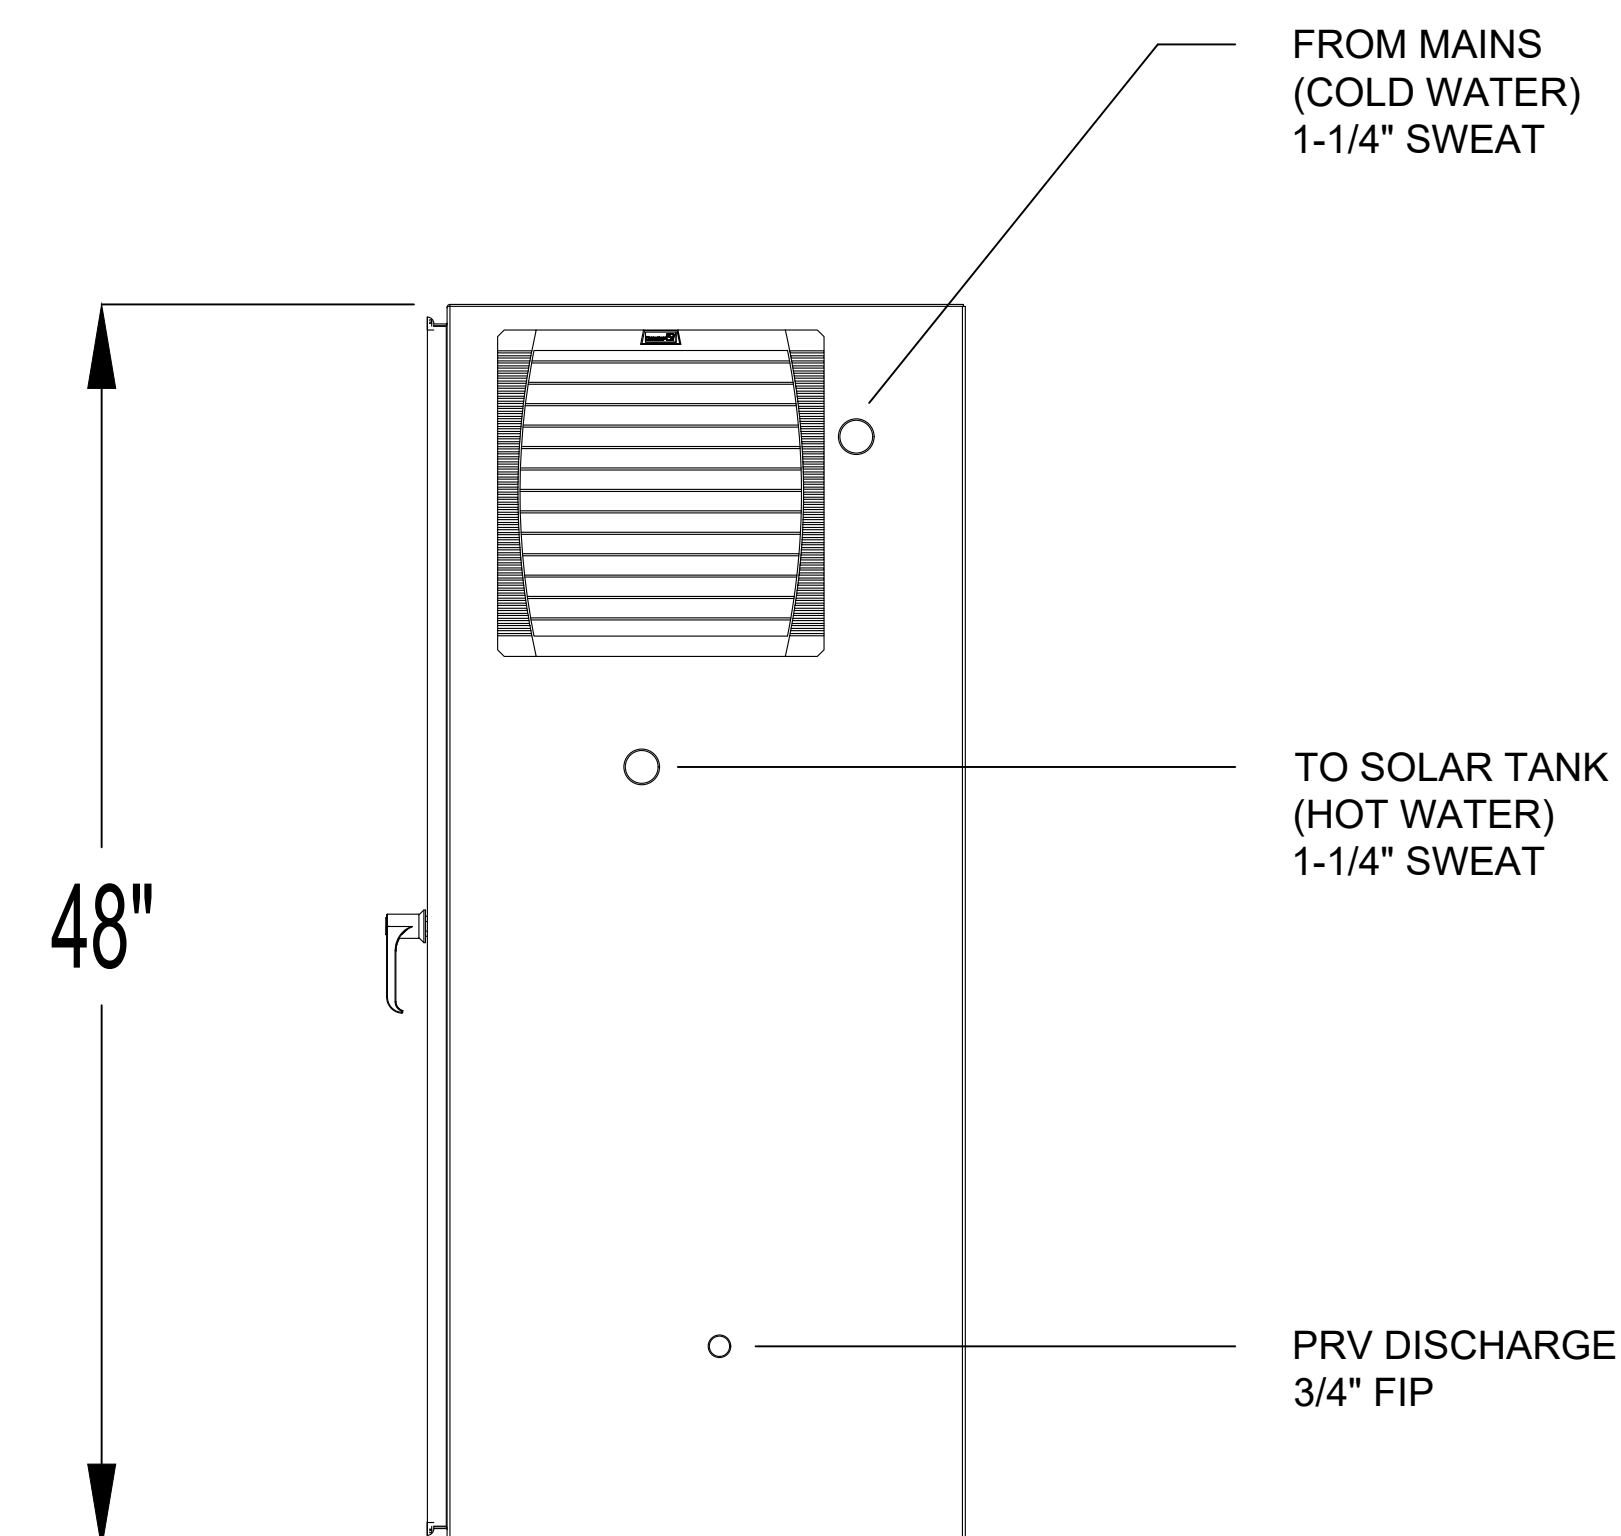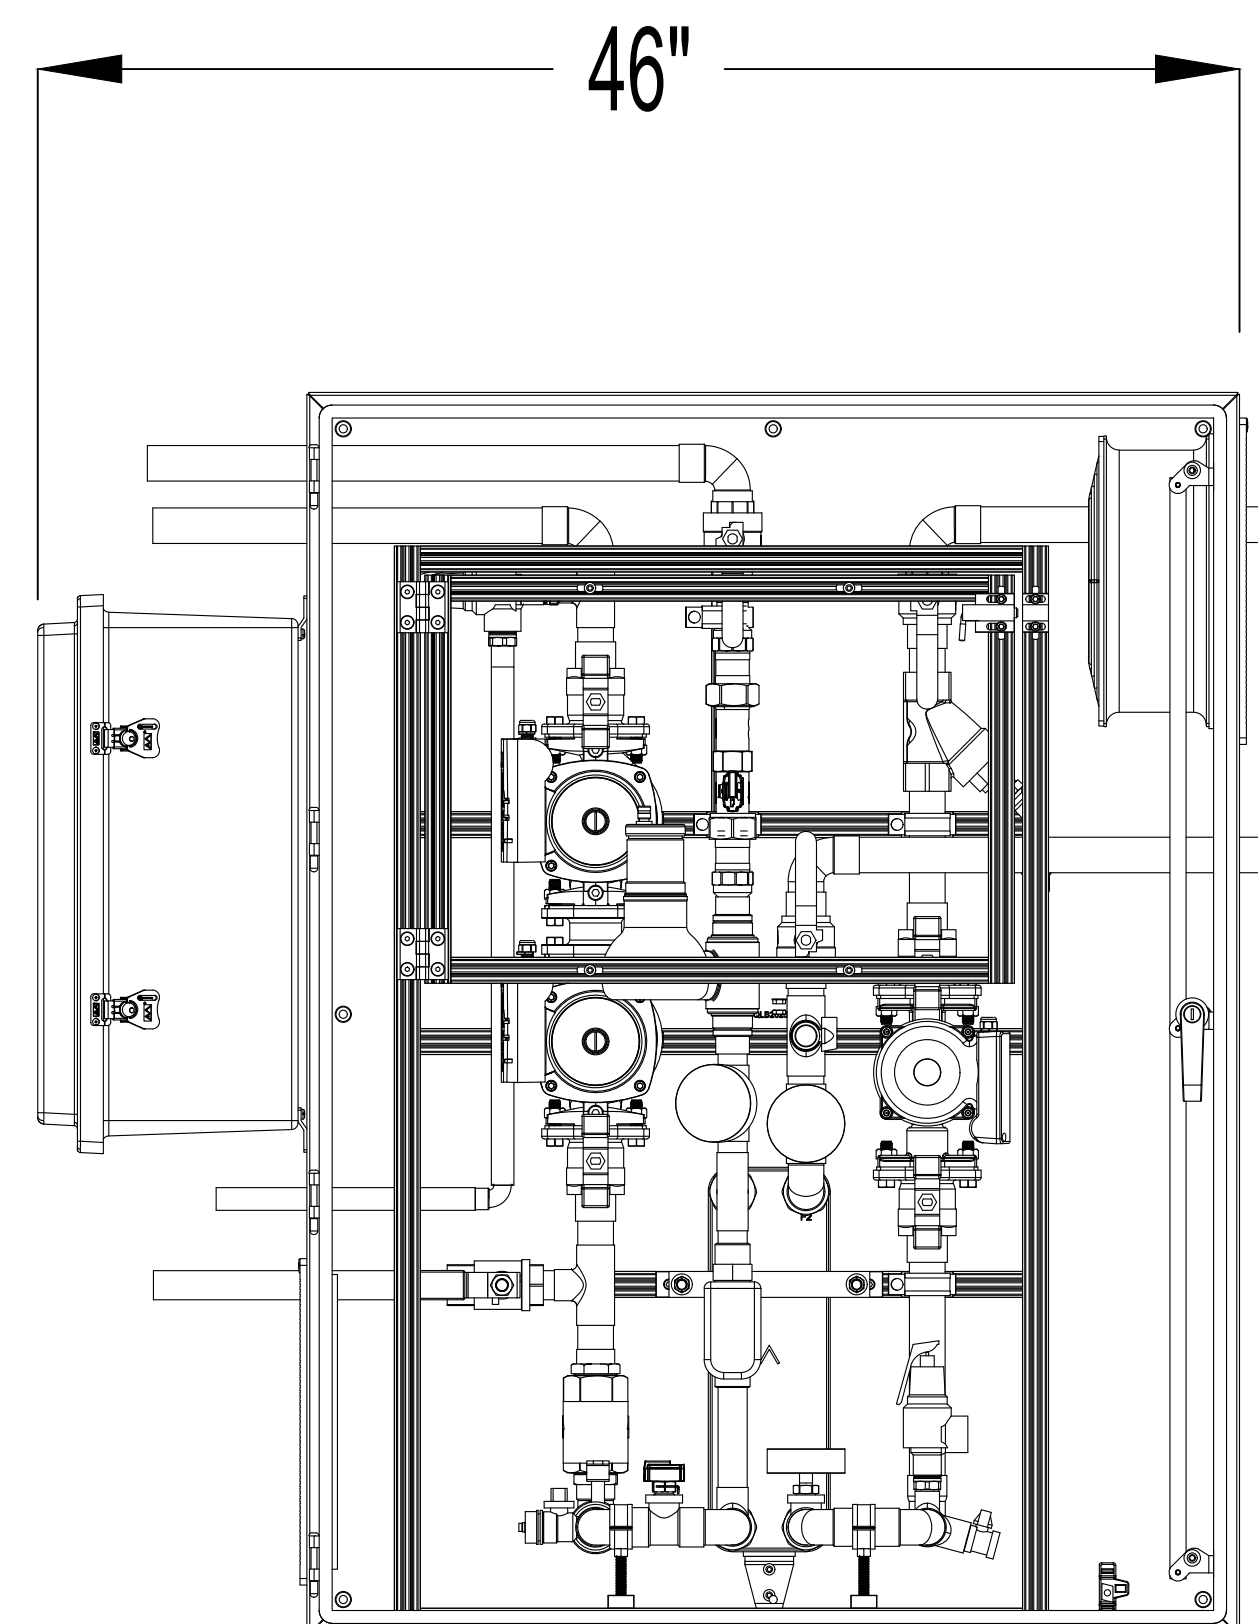

Power Supply Table				
Energy Terminal Size	Required Voltage (VAC)	Required Current (amp)	Required (PH)	Required Frequency (HZ)
SETO-1020-13-50-E1	110	11	1	60

NOTE: Energy Terminal also available in 240 VAC

Company Name

enerworks
Solar Heating and Cooling

Project Name

Solar Thermal System
With SETO-1020-13-50-E1
Hydraulic & Electrical Schematic

Schematic

WAA064

Date

5/6/2021


Scale

As Noted

Sheet

2

WIRING DIAGRAM

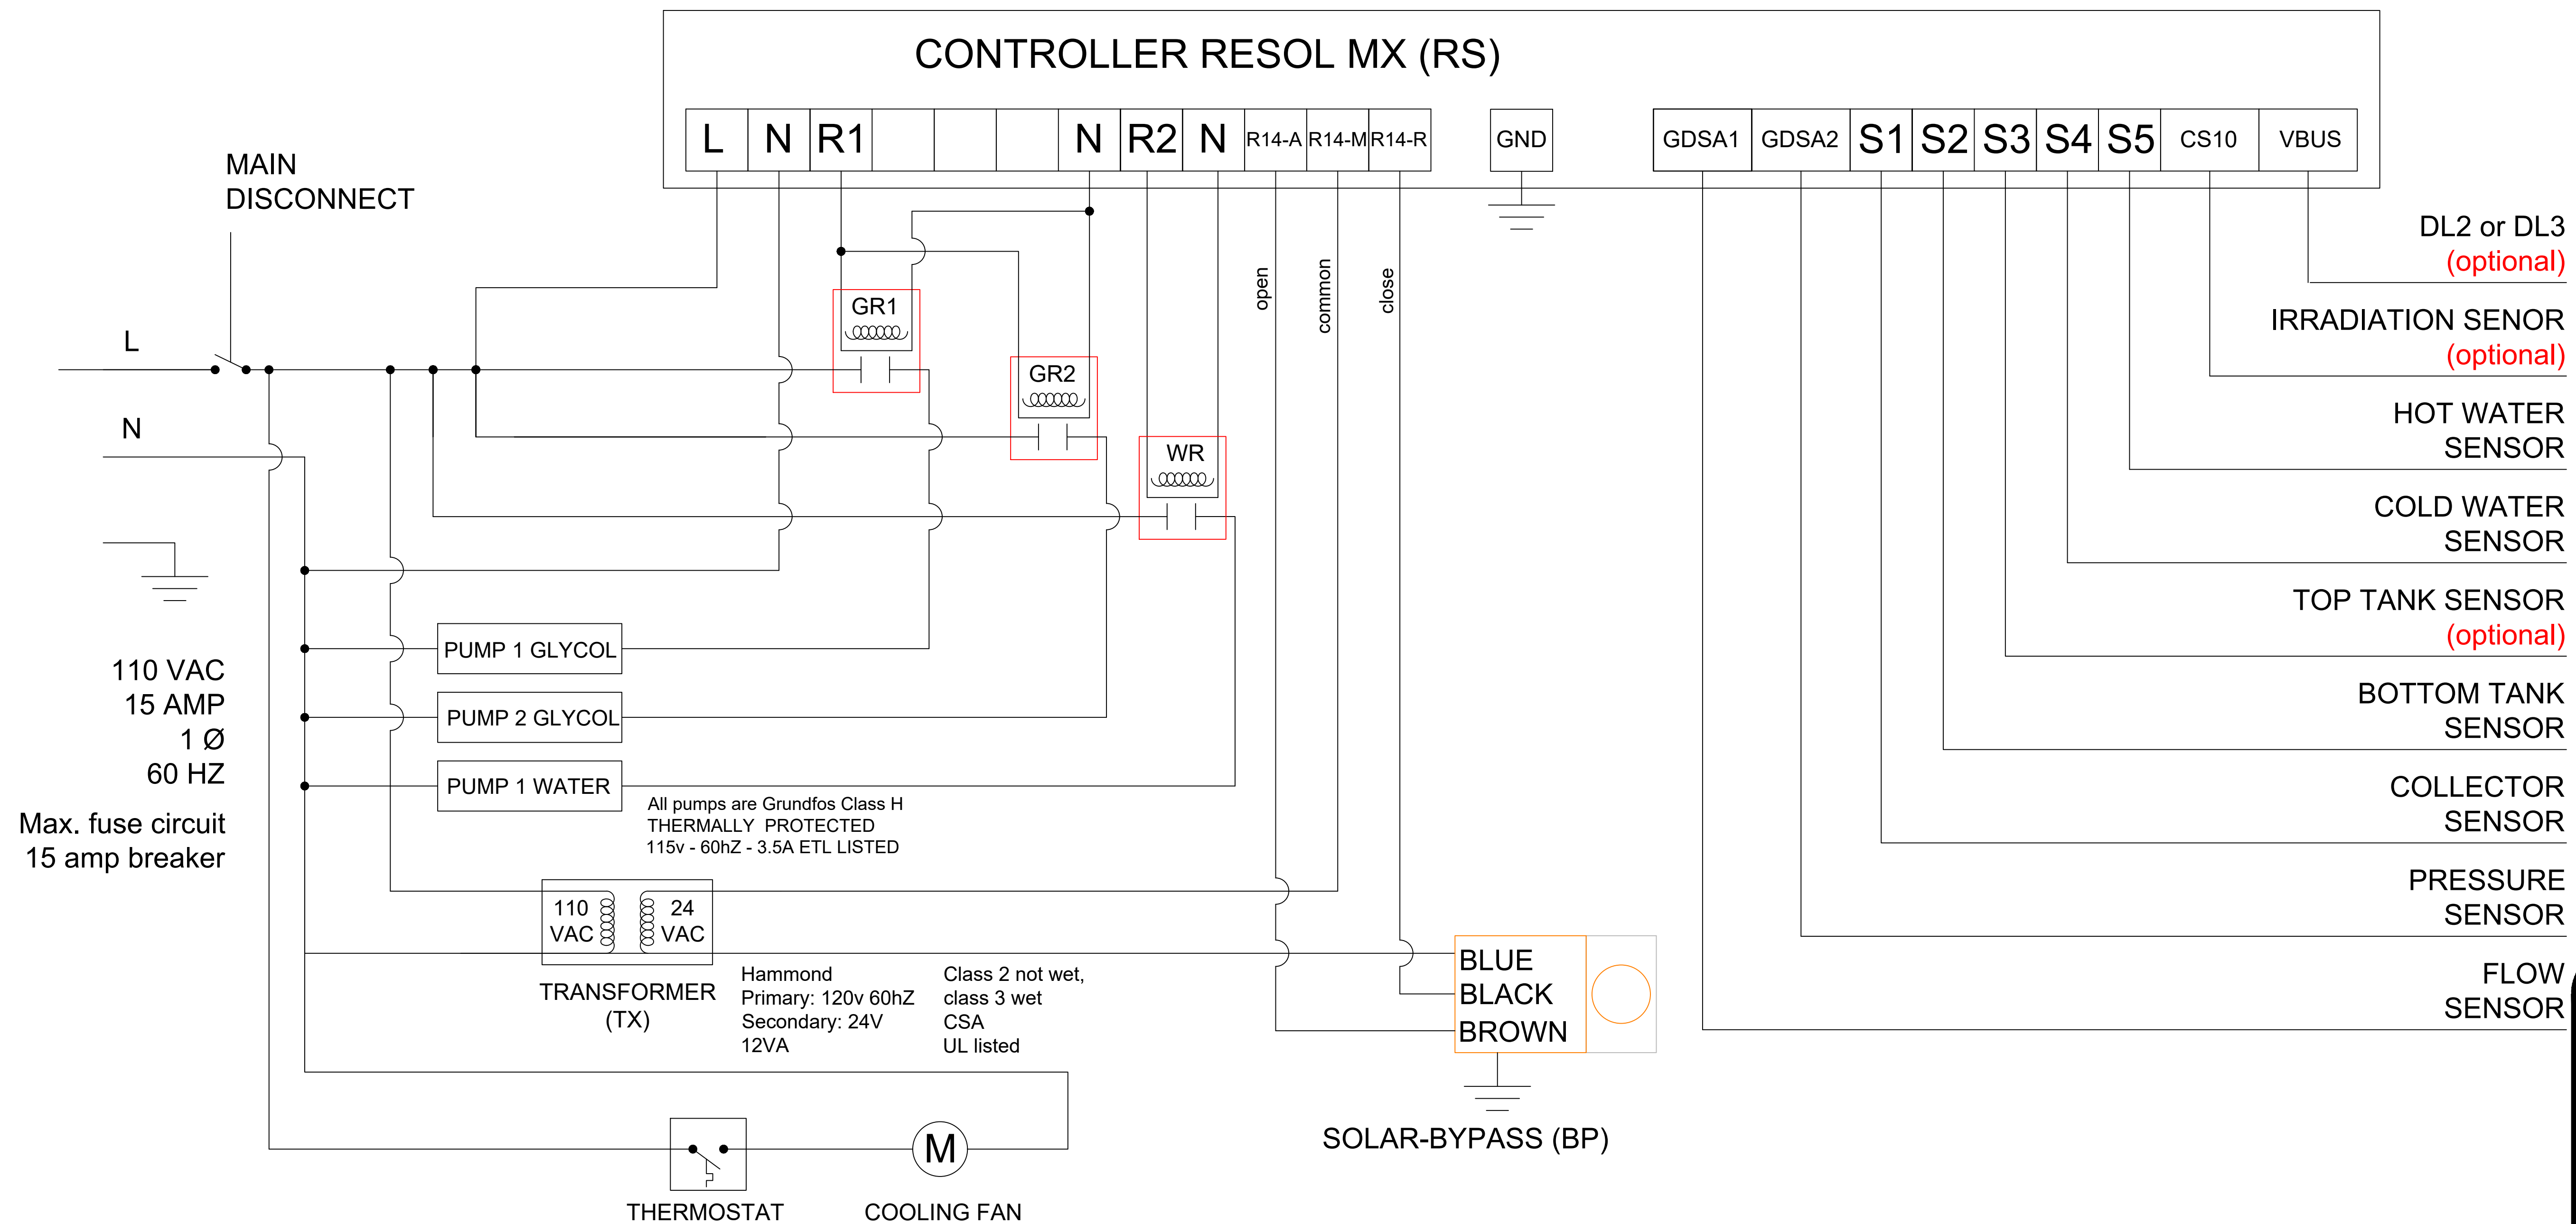

Power Supply Table				
Energy Terminal Size	Required Voltage (VAC)	Required Current (amp)	Required (PH)	Required Frequency (HZ)
SETO-1020-13-50-E1	110	11	1	60

NOTE: Energy Terminal also available in 240 VAC

enerworks Solar Heating and Cooling						
Project Name Solar Thermal System With SETO-1020-13-50-E1 Hydraulic & Electrical Schematic						
<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 60%; padding: 5px;"> Schematic WAA064 </td> <td style="width: 40%; padding: 5px;"> Sheet 3 </td> </tr> <tr> <td style="padding: 5px;"> Date 5/6/2021 </td> <td rowspan="2"></td> </tr> <tr> <td style="padding: 5px;"> Scale As Noted </td> </tr> </table>	Schematic WAA064	Sheet 3	Date 5/6/2021		Scale As Noted	
Schematic WAA064	Sheet 3					
Date 5/6/2021						
Scale As Noted						